

Top 100
Global
Innovator
2021

Up to 24kV

Compact AIS

Compact Air Insulated Switchgear



LS[®] ELECTRIC



Up to 24kV

Compact Air Insulated Switchgear

Contents

• Features	03
• General characteristics	04
• Applications	05
• Units	06
• Internal arc protection	11
• Considerations for high altitude installation	12
• SM VCB	14
• SM LBS	34
• Options for Compact AIS	44
• Digital protection relay	45
• Order form	46
• Certificates	54



Features



Reliability & Safety

- Type testing is complete for all models according to latest standard, IEC62271-200
- Internal arc proofed 21kA / 1s
- Earthing of both the whole switchboard structure and the metal division between the compartments
- Mechanical interlocks which assure the exact operation sequence
- Protection Classes: PI (insulating partition)
- Loss of service continuity classes: LSC2A (LSC1 for bus riser)
- IP3X protection degree on the external housing
- High voltage indication system in each cubicle



Optimization

- Reduced dimensions and weights
- Less space requirement for switchboard installation
- Easy integration in factory-built outdoor substations
- A solution adapted to cable connection
- Modular units containing fixed and withdrawable metal-enclosed switchgear, using vacuum



Simplicity

- Simplified switchboard busbar design
 - Mimic diagram front of the switchboard by means of simple and functional devices
-

General characteristics

Electrical characteristics

Type		Rating				
Rated voltage	Ur		12	17.5	24	
Rated frequency	fr	Hz	50/60			
Insulation level						
Power frequency withstand voltage	Insulation	Ud	1min (kV rms)	28	38	50
	Isolation	Ud	1min (kV rms)	32	45	60
Lightning impulse withstand voltage	Insulation	Ud	1.2/50µs (kV peak)	75	95	125
	Isolation	Ud	1.2/50µs (kV peak)	85	110	145
Breaking capacity						
Rated current	Ir	A	630			
Short-time withstand current	Ik/tk	kA/s	16kA/3s, 21kA/3s, 25kA/1s			
Making capacity (50Hz)	Ima	kA	40 / 50 / 54.6			
Internal arc classification	IAC	kA/1 s	21 (A-FLR): Option			

IEC standards

IEC 62271-1	High-voltage switchgear and controlgear Part 1: Common specifications
IEC 62271-100	High-voltage switchgear and controlgear Part 100: Alternating-current circuit-breakers
IEC 62271-102	High-voltage switchgear and controlgear Part 102: Alternating current disconnectors and earthing switches
IEC 62271-103	High-voltage switchgear and controlgear Part 103: Switches for rated voltages above 1kV up to and including 52kV
IEC 62271-105	High-voltage switchgear and controlgear Part 105: Alternating current switch-fuse combinations
IEC 62271-200	High-voltage switchgear and controlgear Part 200: AC metal-enclosed switchgear and controlgear for rated voltages above 1kV and up to and including 52kV

Normal operating conditions

Ambient air pollution	No significant pollution by dust, smoke, corrosive and/or flammable gases, vapours or salt.
Ambient air temperature	Less than or equal to 40°C Less than or equal to 35°C on average over 24 hours Greater or equal to -5°C
Altitude	Less than or equal to 1000 m
Humidity	Average relative humidity over a 24 hour period, less than or equal to 95% (average relative humidity over a 1 month period, less than or equal to 90%)

Building



- Office building
- Hotel and resort
- Shopping mall
- Hospital
- University

Industry




- Manufacturing industry
- Small size power plant
- Wind power plant

Utility/Public




- Secondary electricity distribution network
- MV/LV distribution transformer substation
- Airport


Units Functions

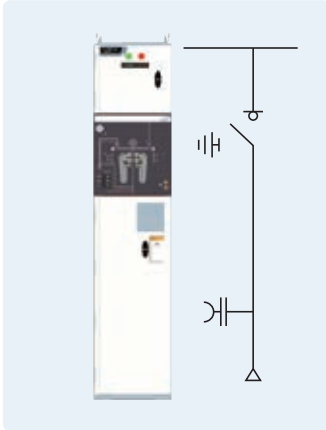


LU
Load break switch unit

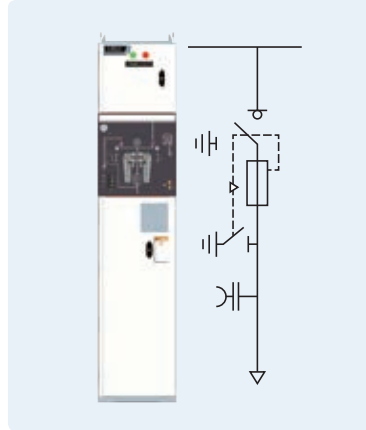


FU
Fuse switch combination unit

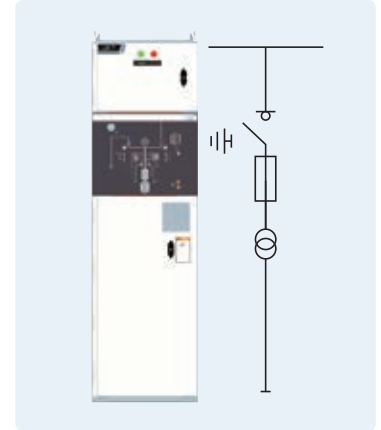


PU
Voltage transformers unit for mains with earthed neutral system

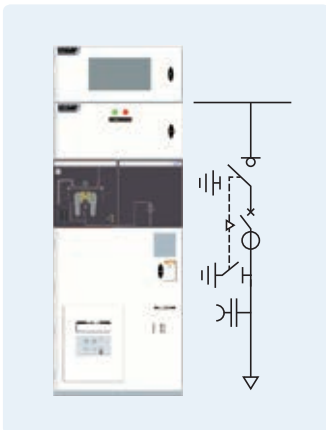


CU-A
Single-isolation, disconnectable circuit breaker unit

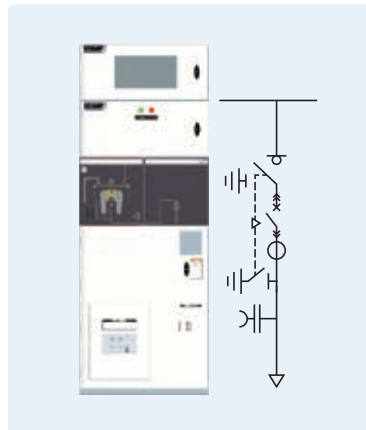


CU-W
Withdrawable single-isolation circuit breaker unit

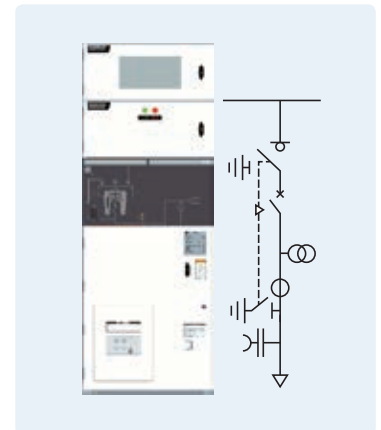


CU-AP
Single-isolation, disconnectable circuit breaker unit with PT

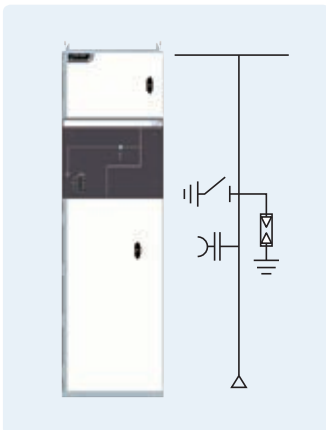

GAU
Incoming cable-connection unit with earthing

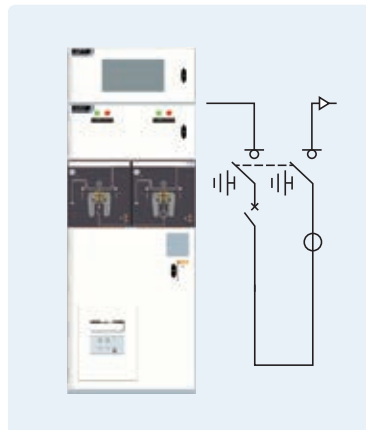


SU
Section unit with double-isolation, disconnectable circuit breaker right or left outgoing line

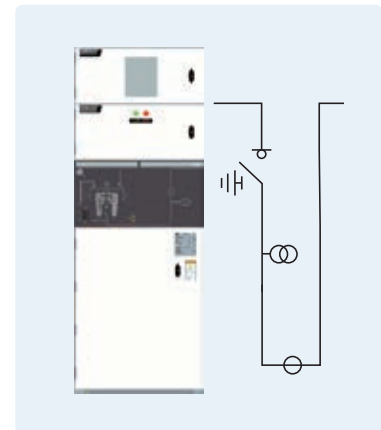

MU
Metering unit

LU – Load break switch unit

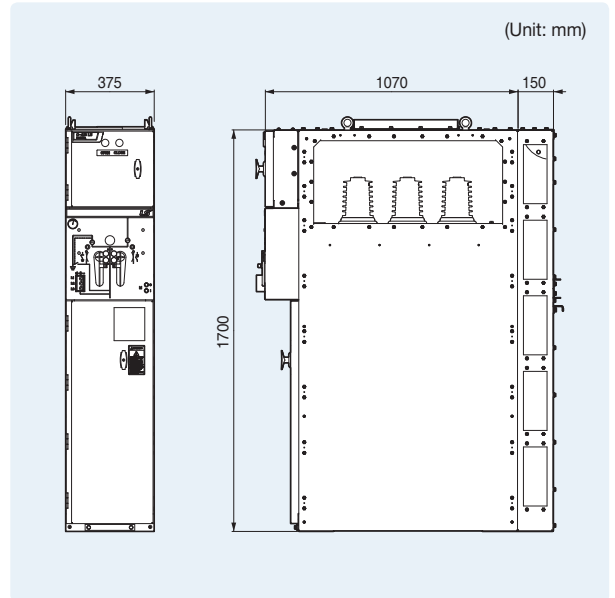

- W×H×D(mm):
375×1,700×1,070
- Load break switch


Base unit

- 3-position load break switch rated 630A for load breaking and earthing
- Key interlock

Optional components

- Motor operation for load break switch
- Voltage detector
- Gas guage (Selection recommended)

FU – Fuse switch combination unit

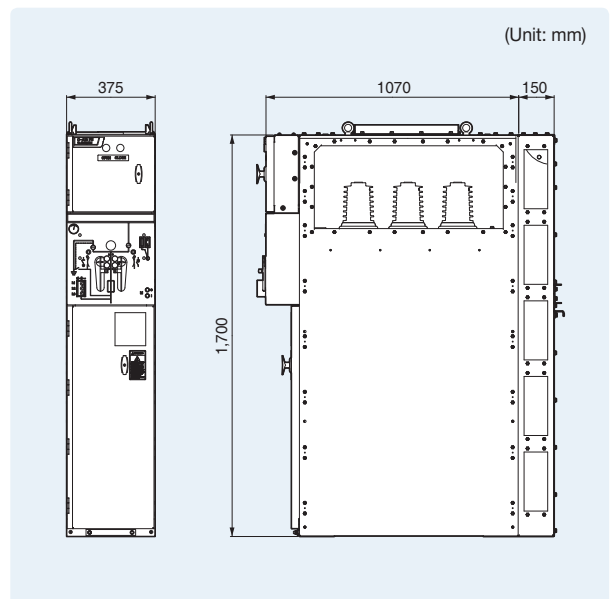

- W×H×D(mm):
375×1,700×1,070
- Fuse switch combination
- Power fuse
- External E/S

Base unit


- 3-position fuse-switch combination with earthing switch
- Key interlock
- Power fuse: 63A

Optional components

- Motor operation for fuse-switch combination
- Voltage detector
- Gas guage (Selection recommended)

Units Dimensions

PU – Voltage transformer unit

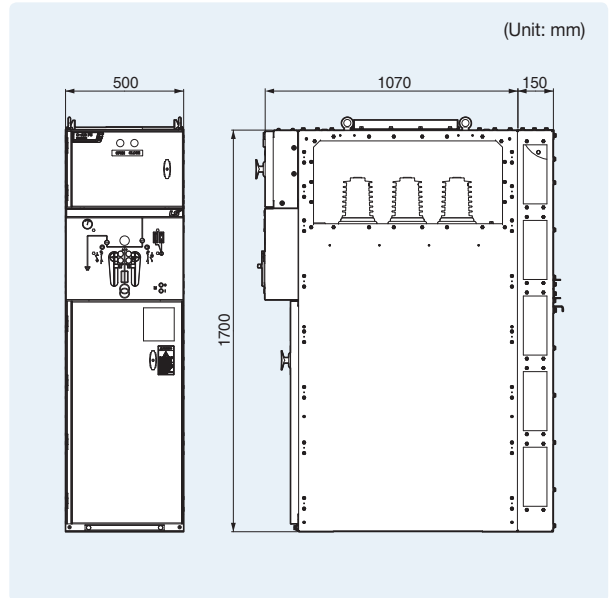

- W×H×D(mm):
500×1,700×1,070
- Fuse switch combination
- Power fuse
- Voltage transformer


Base unit

- 3-position fuse-switch combination with earthing switch
- Key interlock
- Power fuse: 1A

Optional components

- Motor operation for load break switch
- Voltage detector
- Gas guage (Selection recommended)
- Voltage transformer

CU-A/CU-W – Circuit breaker unit

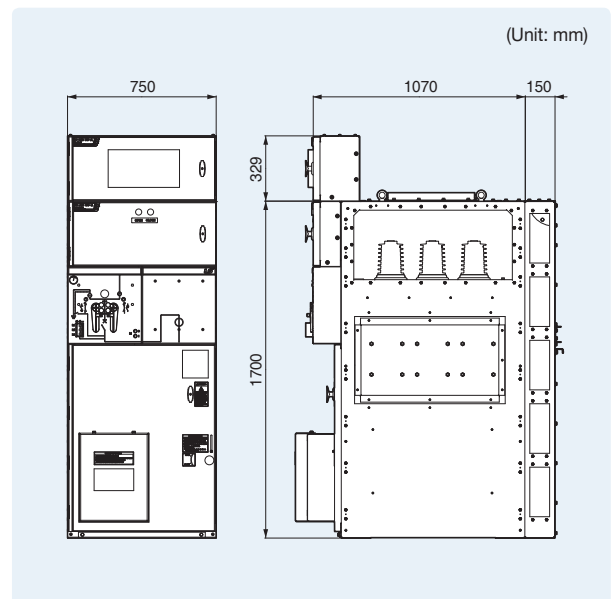

- W×H×D(mm):
750×1,700×1,070
- Load break switch
- Vacuum circuit breaker
- Current transformer
- External E/S

Base unit

- 3cycle circuit breaker
- SM-VCB Auxiliary contacts: 4a4b
- 3-position load break switch rated 630A
- Key interlock

Optional components

- Motor operation for load break switch
- Voltage detector
- Gas guage (Selection recommended)
- Protective relay
- Current transformer


CU-AP - Circuit breaker unit with PT



- W×H×D(mm):
750×1,700×1,070
- Load break switch
- Vacuum circuit breaker
- Current transformer
- Voltage transformer
- External E/S

Base unit


- 3cycle circuit breaker
- SM-VCB Auxiliary contacts: 4a4b
- 3-position load break switch rated 630A
- Key interlock

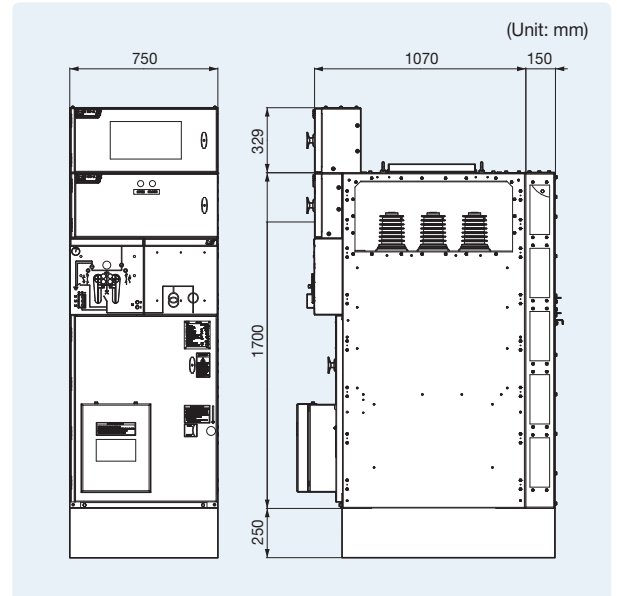

Optional components

- Motor operation for load break switch
 - Voltage detector
 - Gas guage (Selection recommended)
 - Protective relay
 - Block type CT is optional (Ring type CT is generally used)
- * 250mm box is added when applying ring type CT.


GAU – Incoming cable-connection unit

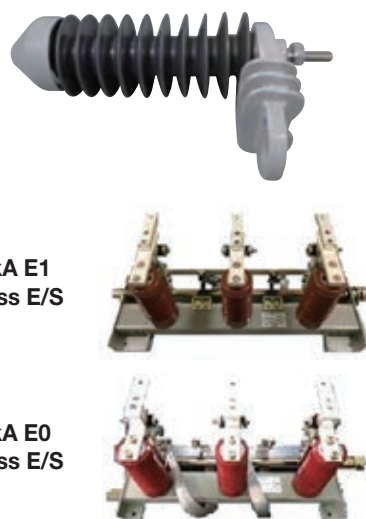

21kA E1
class E/S

21kA E0
class E/S

- W×H×D(mm):
500×1,700×1,070
- External E/S
- Lightning arrester

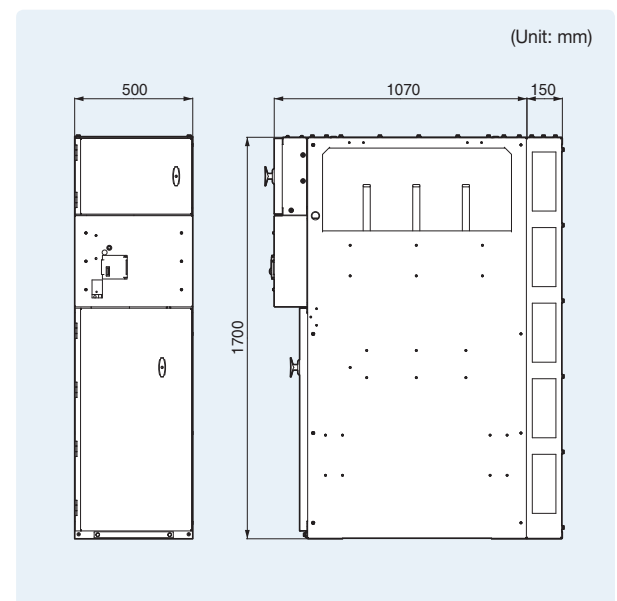

Optional components

- Voltage detector
- Lightning arrester

Units Dimensions


SU – Section unit



- W×H×D(mm):
750×1,700×1,070
- Load break switch
- Vacuum circuit breaker
- Current transformer
- External E/S

Base unit

- 3cycle circuit breaker
- SM-VCB Auxiliary contacts: 4a4b
- 3-position load break switch rated 630A
- Key interlock

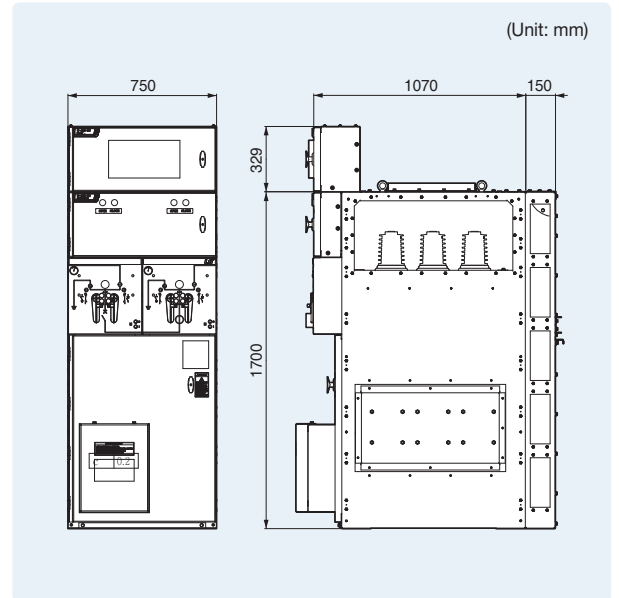

Optional components

- Motor operation for load break switch
- Voltage detector
- Gas guage (Selection recommended)
- Protective relay
- Current transformer


MU - Metering unit



- W×H×D(mm):
750×1,700×1,070
- Load break switch
- Current transformer
- Voltage transformer

Base unit

- 3-position load break switch rated 630A
- Key interlock

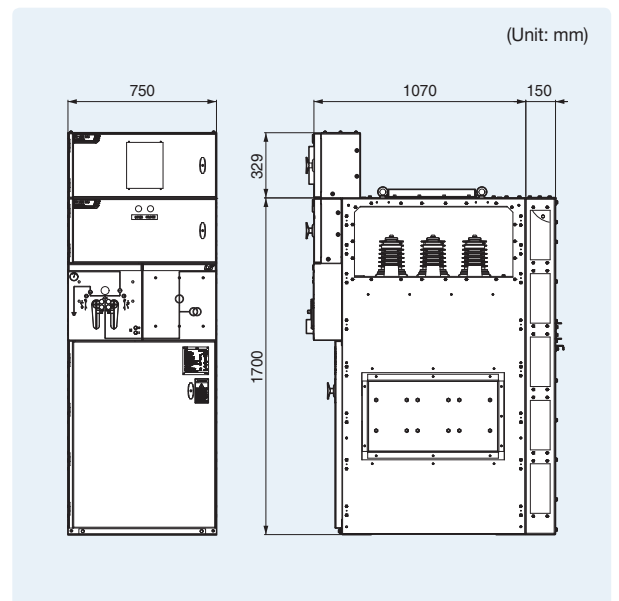


Optional components

- Gas guage (Selection recommended)


LS Compact AIS is designed to enhance user safety with internal arc structure so that an operator can be protected from effects of an internal arc fault. LS Compact AIS has passed internal arc tests in conformity with IEC 62271-200.

Layout examples

Example of installation of compact AIS

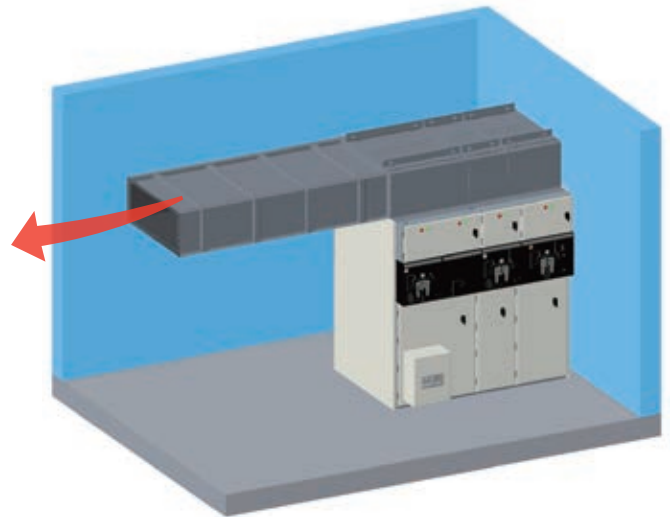


Top view

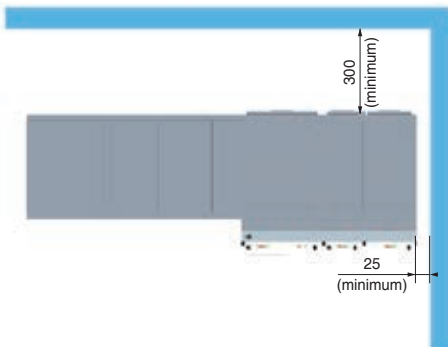

Front view




Side view

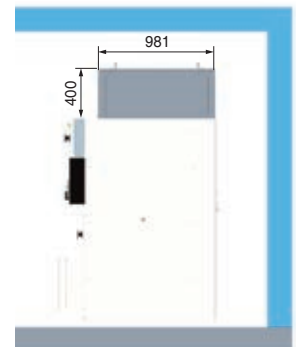

Features

Internal arc withstand

- Classified IAC: A-FLR (4-sides internal arc protection)
 - 21kA/1s
- Arc duct type
 - Arc duct is necessary on the top of the switchgear
 - ① supplied
 - ② not supplied

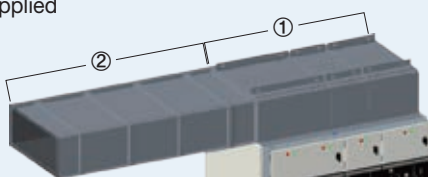

For user safety

- Compartment type enclosure
 - Metal division between the compartments
- safety devices
 - Voltage indication system
 - Mechanical interlocks for accurate operation sequence
- Technologies for safety
 - Structural design & analysis
 - : Arc relief structure
 - Insulation design
 - : Reliability of insulation materials
 - Electromagnetic field analysis

Considerations for high altitude installation

The installation at an altitude above 1,000m has an impact on the dielectric behavior of medium voltage air insulated switchgears. For this reason, some factors must be considered in operating medium voltage air insulated switchgears in high altitude conditions.


Altitude correction factors for insulation

As the altitude increases, the dielectric strength of insulation decreases due to the reduced air density. For installation at an altitude higher than 1,000m above sea level, the insulation withstand level of external insulation at the service location shall be determined by multiplying the rated insulation levels by a factor "Ka" in accordance with below formula. (IEC 62271-1 standards)

$$K_a = e^{m(H - 1000)/8150}$$

H = altitude in meters

m = 1 (for power-frequency, lightning impulse and phase-to-phase switching impulse voltages)

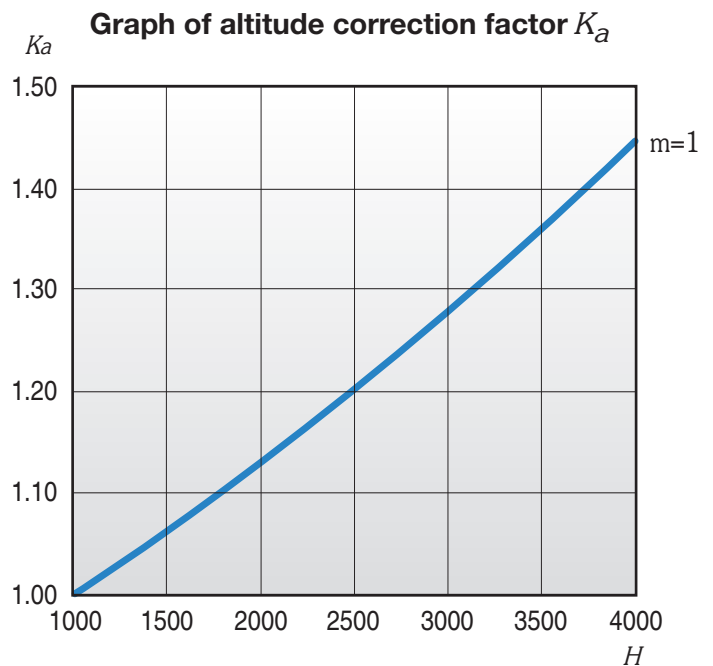

Example

- Installation altitude: 4,000m
- Rated voltage: 12kV
- Power frequency withstand voltage: 28kV rms
- Lightning impulse withstand voltage: 75kV peak
- According to the above formular, $K_a = 1.44$

- Power frequency withstand voltage to be selected : $28 \times 1.44 = 40.3\text{kV rms}$
- Lightning impulse withstand voltage to be selected : $75 \times 1.44 = 108\text{kV peak}$

For installation at an altitude of 4,000m above sea level with 12kV rated voltage, C-AIS for a rated voltage 24kV with insulation levels at power frequency of 50kV rms and 125kV peak impulse withstand voltage should be selected.

Altitude correction factors for current

According to ANSI standard, for unusual conditions such as altitude, it is recommended the use of correction factors for the current and voltage as follows:

Altitude (m)	1,000	1,200	1,400	1,600	1,800	2,000	2,500	3,000	3,500	4,000
Altitude (ft)	3,280	3,940	4,600	5,250	5,900	6,560	8,200	9,840	11,500	13,125
ACF for current	1.00	0.996	0.992	0.988	0.984	0.980	0.970	0.960	0.950	0.940
ACF for voltage	1.00	0.98	0.96	0.94	0.92	0.90	0.85	0.80	0.75	0.70

Example

LS C-AIS with 630A of rated current in normal operating conditions has about 592A ($630 \times 0.940 = 592A$) capability at 4,000m altitude. But it will have no problem in the majority of cases because switchgear is not often applied at the limits of its rated current capability for most applications.

Distortion of gas insulated electrical equipment

The atmospheric pressure decreases with an increase in altitude. In case of gas insulated electrical equipment such as LBS, the tank might be able to distorted due to the larger pressure difference between inside and outside of the tank at high altitude. So, for high altitude installation the equipment should be examined whether it works normally.

Example


The absolute pressure of SF₆ gas in LS LBS is 125kPa. As the altitude increases, higher pressure is caused to the tank by the decreasing atmospheric pressure. At 4,000m altitude, the pressure difference between the inside and outside of the tank is 2.67 times bigger than at 0 m.

Altitude above sea level (m)	0	1,000	2,000	3,000	4,000
Internal pressure of LBS: SF₆ gas (kPa)	125	125	125	125	125
External pressure of LBS: Absolute atmospheric pressure (kPa)	101.33	89.87	79.50	70.11	61.64

LS has examined the normal operation and capability of LBS under the same pressure difference condition as at 4,000m altitude.


Main circuit structure with high reliability

SM VCB (Side mount breaker)

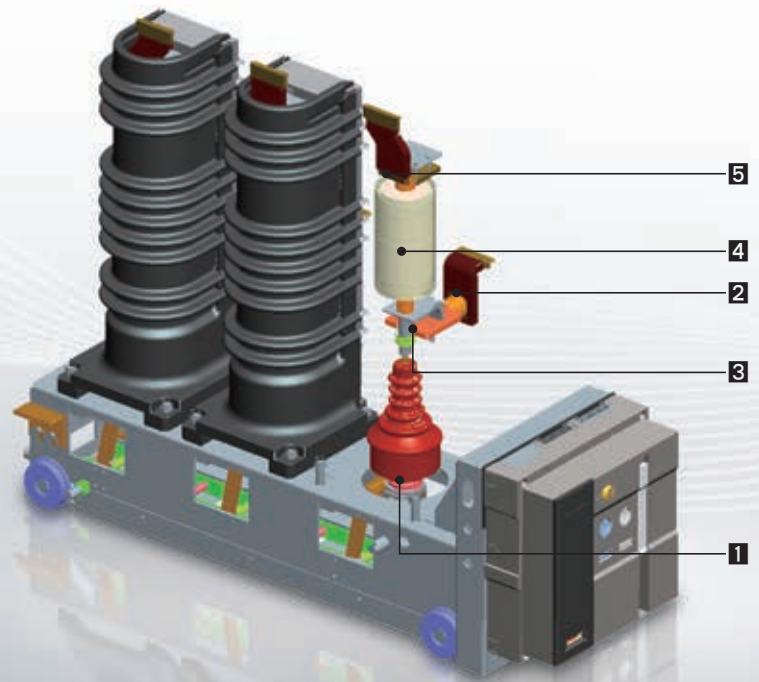

Breaker

- 1 Insulation rod
- 2 Lower terminal
- 3 Shunt
- 4 Vacuum interrupter
- 5 Upper terminal

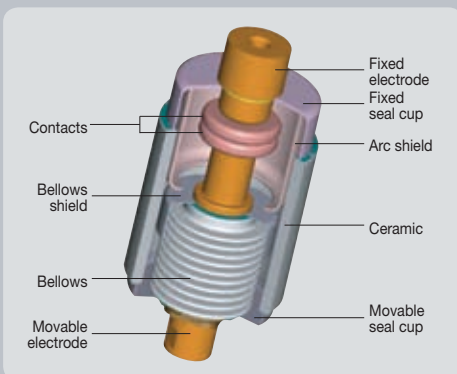

Vacuum Interrupter (VI)


The vacuum rate within the VI is very high (approximately 5×10^{-5} Torr) and the spacing between fixed contact and movable contact is about 6~20mm, depending on the voltage.

The contacts are in a structure that arc can easily be extinguished and the surfaces of

the contacts are made of special alloy (copper-chromium) and the interior is completely sealed to prevent loss of vacuum.

Therefore the wearing of the contacts can be minimized in the event of short-circuit and the arc energy by overvoltage or switching can be reduced effectively.

Ratings

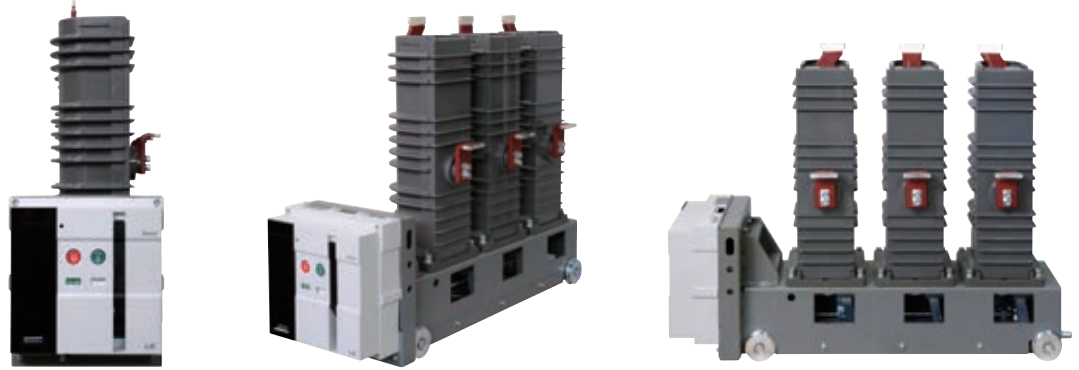

Insulation level		SVL-06□20,25□06,13	SVL-12□16,20,25□06,13	SVL-17□16,20,25□06,13	SVL-20□16,20,25□06,13	SVL-25□16,20,25□06,13
Rated voltage	Ur (kV)	7.2	12	17.5	24	25.8
Rated normal current	Ir (A)	630 1250	630 1250	630 1250	630 1250	630 1250
Phase distance	(mm)	210 (Fixed), 230 (Fixed/Withdrawable), 254 (Fixed)				
Weight (Fixed type)	(kg)	80, 90 (Phase distance 254 only)				
Weight (Withdrawable type)	(kg)	85				
Rated frequency	fr (Hz)	50/60				
Rated short-circuit current	Isc (kA)	20, 25	16, 20, 25			
Rated short-circuit breaking capacity	(MVA)	249, 312	333, 415, 520	485, 606, 758	665, 831, 1039	715, 894, 1117
Rated short-time withstand current	Ik/tk(kA)	16/3 (4*), 20/3 (4*), 25/3 (4*)				
Rated short-circuit making current	Ip (kA)	2.5 Isc (50Hz)/2.6 Isc (60Hz)				
Rated breaking time	(cycle)	3				
Rated withstand voltage	Power frequency Ud (kV)	20	28	38	50	60
	Impulse	60	75	95	125	125
Rated operating sequence		O-0.3s-CO-15s-CO				
Control voltage	Closing coil (V)	DC 24~30V, DC 48~60V, DC 110V, DC 125V, DC 220V, AC 48V, AC 100~130V, AC 220~250V				
	Trip coil (V)	DC 24~30V, DC 48~60V, DC 110V, DC 125V, DC 220V, AC 48V, AC 100~130V, AC 220~250V				
Auxiliary contacts		4a4b, 10a10b				
Rated opening time	(s)	≤ 0.04				
No-load closing time	(s)	≤ 0.07				
Type test class	Mechanical	M2				
	Electrical	E2 (List3)				
	Capacitive current switching	C2				
Type	Fixed type	R/L type				
	Withdrawable type	S/T type				
Standards		IEC62271-100				

Note) For C-AIS, only 230mm (phase to phase) right type SM VCB is available

SM VCB

Types and ordering information


SVL	—	06	R	20	H	06
Basic model name		Rated voltage (kV)	Version	Interrupting current (kA)	Phase distance / Compatibility	Rated current (A)
SVL SM VCB		06 7.2	R Fixed type right	16 16	B 210mm	06 630A
		12 12	L Fixed type left	20 20	H 230mm	13 1250A
		17 17.5	S Withdrawable type right	25 25	C 254mm	
		20 24	T Withdrawable type left	* 7.2kV Model 20, 25kA only		
		25 25.8		* 230 (Withdrawable type only)		

SVL-06R20H06	—	M1	C1	T1	SA2	U1	A	1 2 3...
		Motor control voltage		Trip coil voltage		UVT		
		M0 -		T0 -		U0 -		
		M1 DC 110V		T1 DC 110V		U1 DC 110V		
		M2 DC 220V		T2 DC 220V		U2 DC 220V		
		M3 DC 125V		T3 DC 125V		U3 DC 125V		
		M4 DC 24V~30V		T4 DC 24V~30V		U4 DC 24V~30V		
		M5 DC 48V~60V		T5 DC 48V~60V		U5 DC 48V~60V		
		M6 AC 48V		T6 AC 48V		U6 AC 48V		
		M7 AC 100V~130V		T7 AC 100V~130V		U7 AC 100V~130V		
		M8 AC 200V~250V		T8 AC 200V~250V		U8 AC 200V~250V		
			Closing coil voltage		Connector and wire		Other accessories	
			C0 -		SA2 Standard A type connector, 4a4b		A1 Secondary trip coil	
			C1 DC 110V		SA4 Standard A type connector, 10a10b		A2 Secondary trip coil with TCS contact	
			C2 DC 220V		SB6 Flame retardant A type connector, 4a4b		A3 -	
			C3 DC 125V		SB8 Flame retardant A type connector, 10a10b		A4 -	
			C4 DC 24V~30V				A5 -	
			C5 DC 48V~60V				A6 -	
			C6 AC 48V				A7 Keylock	
			C7 AC 100V~130V				A8 Button padlock	
			C8 AC 200V~250V				A9 Button cover	
							AA Lead wire	
							AB User plug (Part)	
							AV CT operated coil 1A	
							AW CT operated coil 5A	

Note)

1. If A1 (Secondary trip coil), A7 (Keylock), A8 (Button padlock) are selected, A148 is the type name in the ordering.
2. A1 (Secondary trip coil), U1~U8 (UVT) can not be selected simultaneously.
3. A8 (Button padlock) and A9 (Button cover) can not be selected simultaneously.
4. If A1 (Secondary trip coil) is selected, Auxiliary contacts is max 9a9b
5. If A2 (Secondary trip coil with TCS contact) are selected, Auxiliary contacts is max 4a3b, 9a8b
6. If AV (CTC 1A), AW (CTC 5A) are selected, Auxiliary contacts is max 4a4b
7. AV (CTC 1A), AW (CTC 5A), SA4 (10a10b), SA8 (10a10b) are only available on phase distance 254mm.


Control circuit diagram

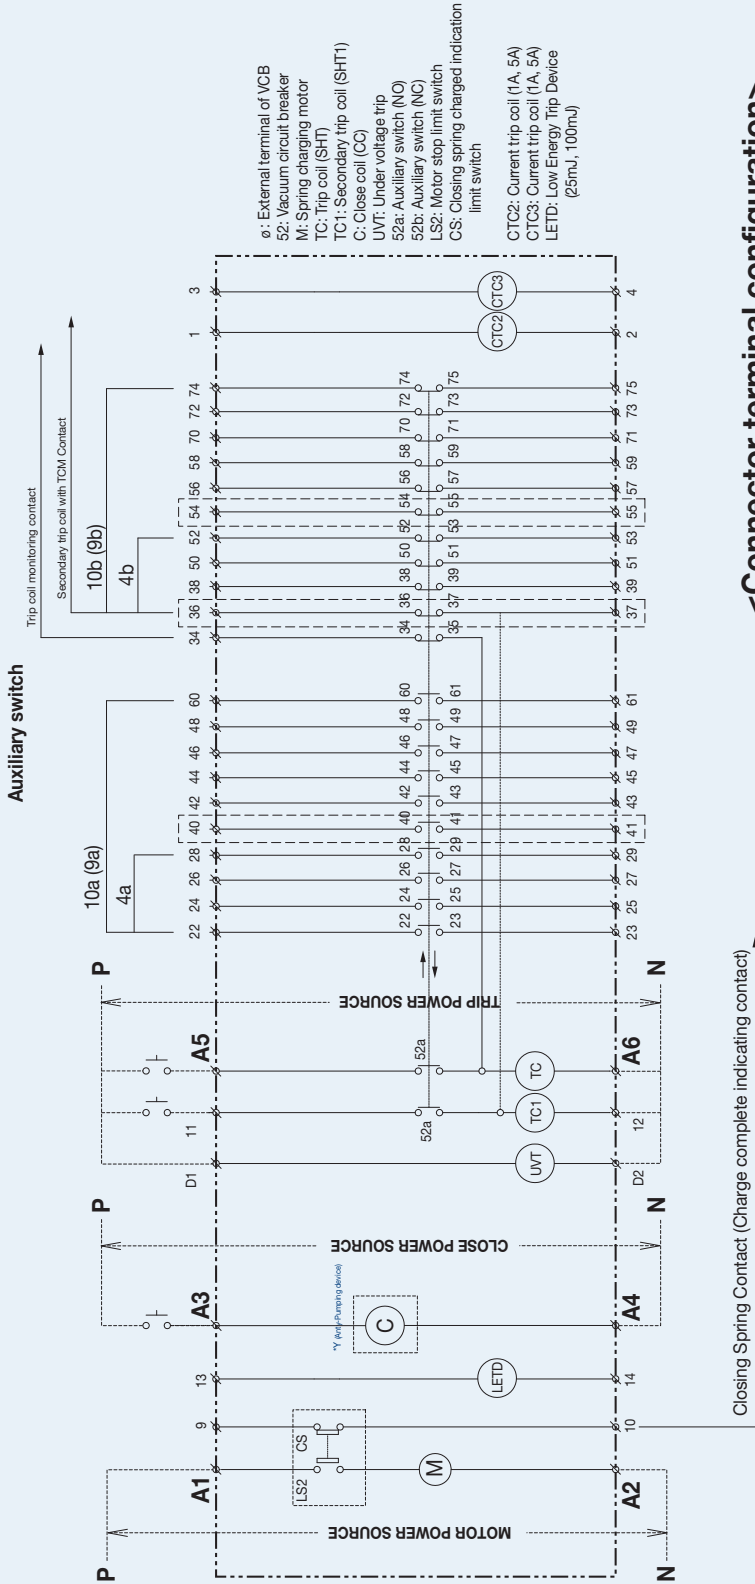


- α: External terminal of VCB
- 52: Vacuum circuit breaker
- M: Spring charging motor
- TC: Trip coil (SHT)
- TC1: Secondary trip coil (SHT1)
- C: Close coil (CC)
- UVT: Under-voltage trip
- 52a: Auxiliary switch (NO)
- 52b: Auxiliary switch (NC)
- LS2: Motor stop limit switch
- CS: Closing spring charged indication limit switch
- CTCT2: Current trip coil (1A, 5A)
- CTCT3: Current trip coil (1A, 5A)
- LETD: Low Energy Trip Device (25mJ, 100mJ)

<Connector terminal configuration>

A Type

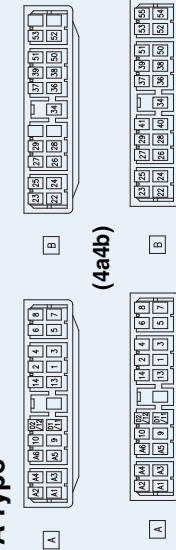

Option



- Note)**
1. CTCT2: Current Trip Coil(A, 5A) (Terminal NO.: 1, 2)
 2. UVT: Under Voltage Trip (Terminal NO.: D1, D2)
 3. TC1: Secondary Trip Coil (Terminal NO.: 1, 12)
In case TC1 is selected and auxiliary switch is 10a10b, Some 'a' contact (Terminal No.: 40, 41) and 'b' contact(Terminal No.: 54, 55) are not available.
 4. Secondary Trip Coil Monitoring Contact (Terminal NO.: 36)
In case Secondary Trip Coil TCM Contact is selected and auxiliary switch is 9a8b, Some 'a' contact (Terminal No.: 40,41) and 'b' contact(Terminal No.: 1, 2) are not available.
 5. CTCT2 - Current Trip Coil (Terminal No.: 1, 2)
CTCT3 - Current Trip Coil (Terminal No.: 3, 4)
 6. LETD - Low Energy Trip Device (Terminal No.: 13,14)
 7. Close and Trip coil is One Pulse type, excluding Trip coil (DC110, 220V)
 8. In above optional accessories, UVT and TC1 can not be selected simultaneously.
 9. Above circuit diagram is based on "OFF" state of VCB and closing spring is charged.
 10. Directions of P and N must be followed, which are written at circuit diagram.






- *Y: Anti-pumping device**
- Anti-pumping device Y supply anti-pumping function to VCB as below. It is composed with circuit in close coil and mechanism. In case the closing coil(C) becomes permanently energized, the circuit breaker remains in the open position after it has been opened, either by manual or electrical operation. The circuit breaker can be closed only if the closing coil(C) is momentarily de-energized.
- ※ Anti-pumping device (IEC62271-100 6.3.128)
: a device which prevents reclosing after a close-open operation as long as the device initiating closing is maintained in the position for closing Anti-pumping device is basically installed

SM VCB Dimensions

24kV, 25kA, 1250A

Fixed (Right type, phase distance 210mm)

(Unit: mm)

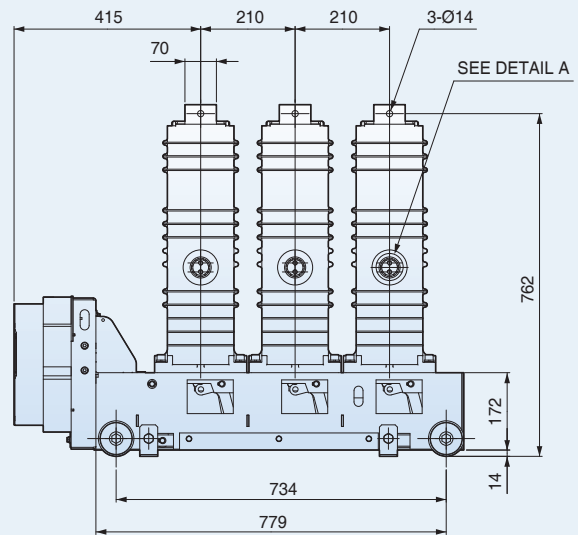
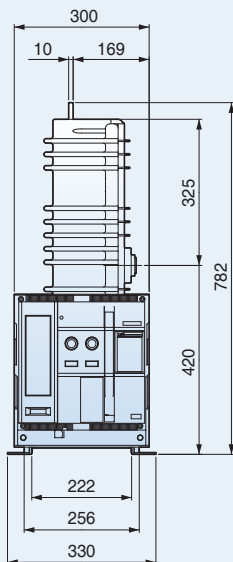
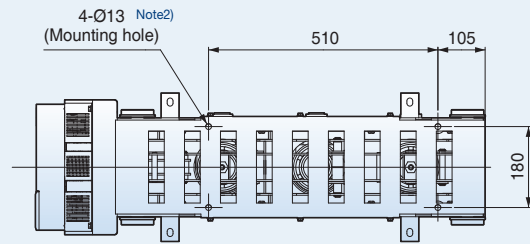
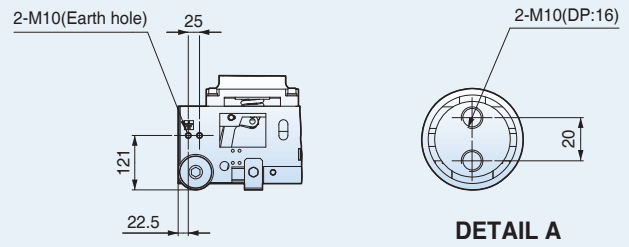
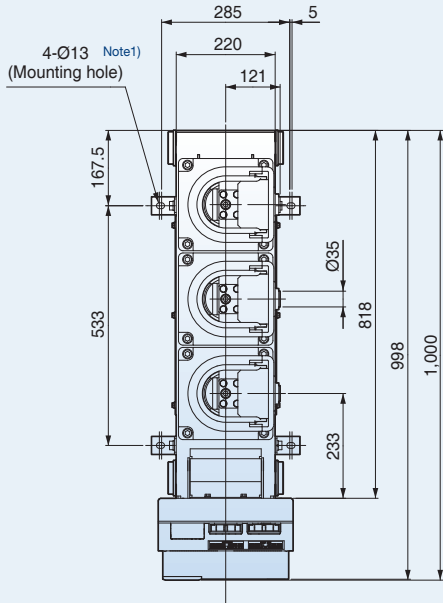


Note)

1. Mounting hole 01 for compact AIS panel
2. Mounting hole 02 for using SM VCB only
3. If using mounting hole 02, four brackets attached to the frame for mounting hole 01 can be removed.

24kV, 25kA, 1250A
Fixed (Right type, phase distance 230mm)

(Unit: mm)

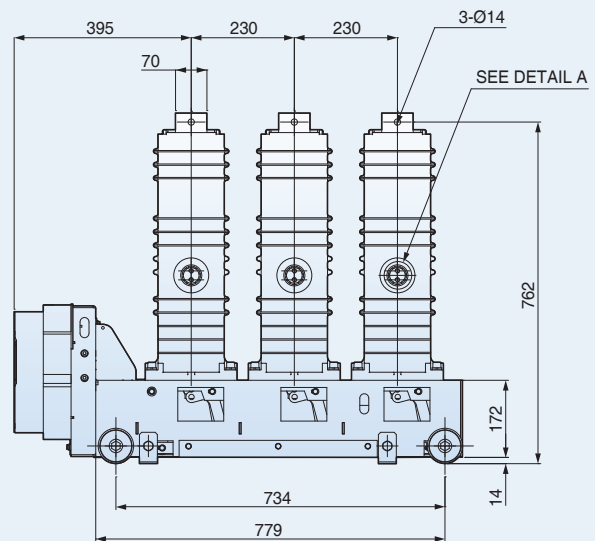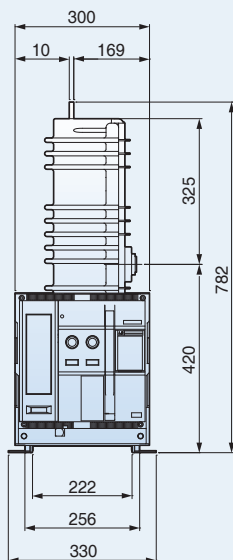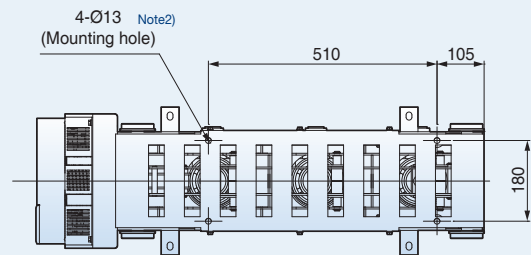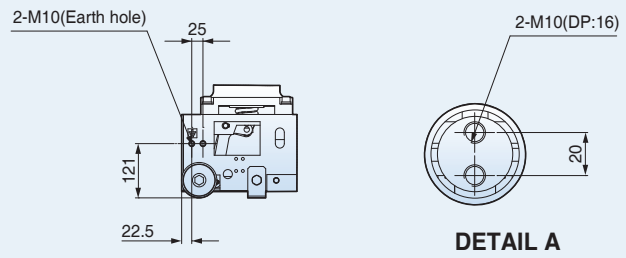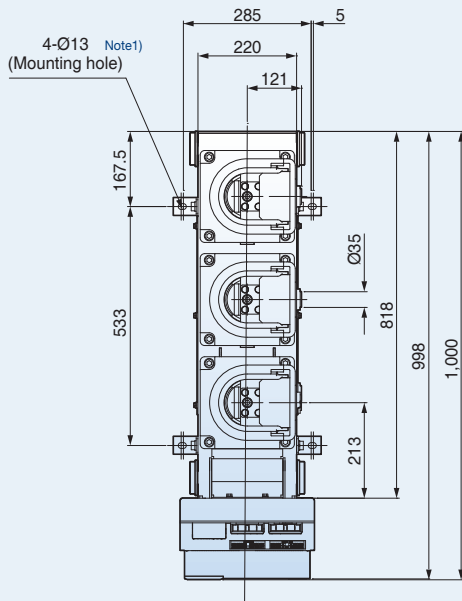

Note)






1. Mounting hole 01 for compact AIS panel
2. Mounting hole 02 for using SM VCB only
3. If using mounting hole 02, four brackets attached to the frame for mounting hole 01 can be removed.

SM VCB Dimensions

24kV, 25kA, 1250A

Fixed (Right type, phase distance 254mm)

(Unit: mm)

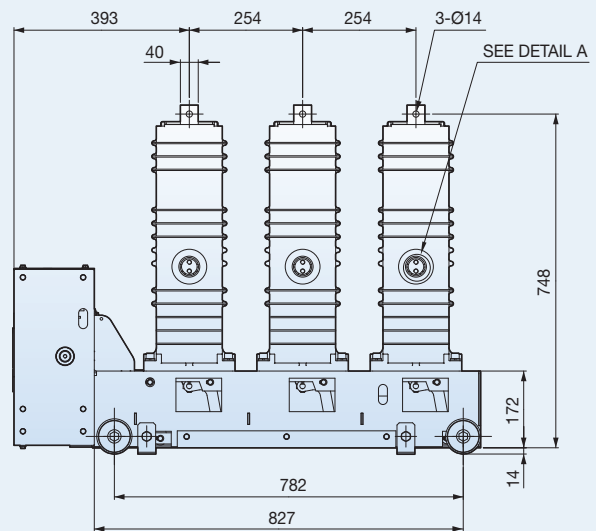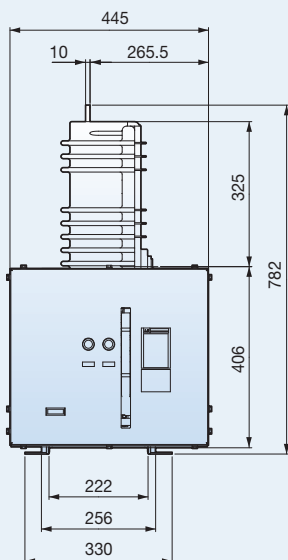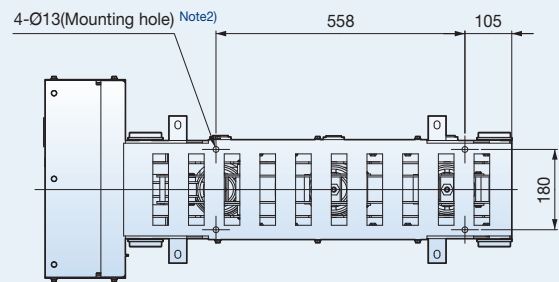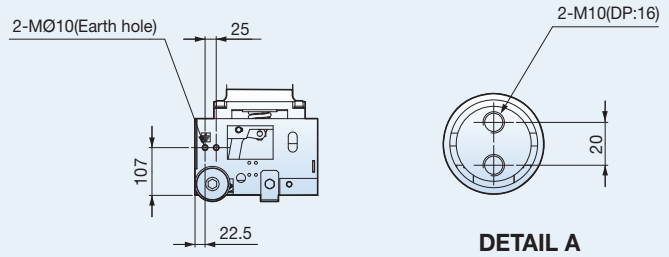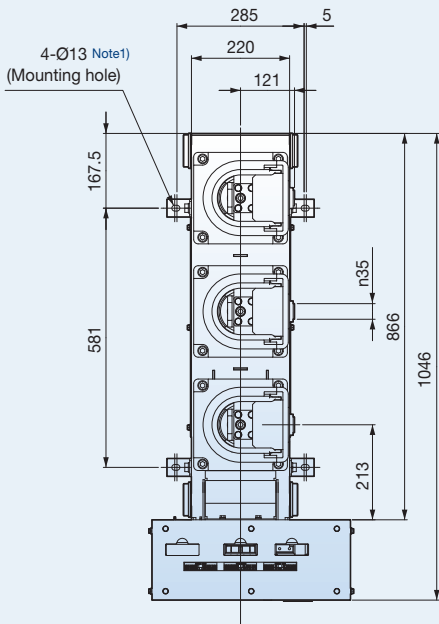


Note)

1. Mounting hole 01 for compact AIS panel
2. Mounting hole 02 for using SM VCB only
3. If using mounting hole 02, four brackets attached to the frame for mounting hole 01 can be removed.

24kV, 25kA, 1250A
Fixed (Left type, phase distance 210mm)

(Unit: mm)

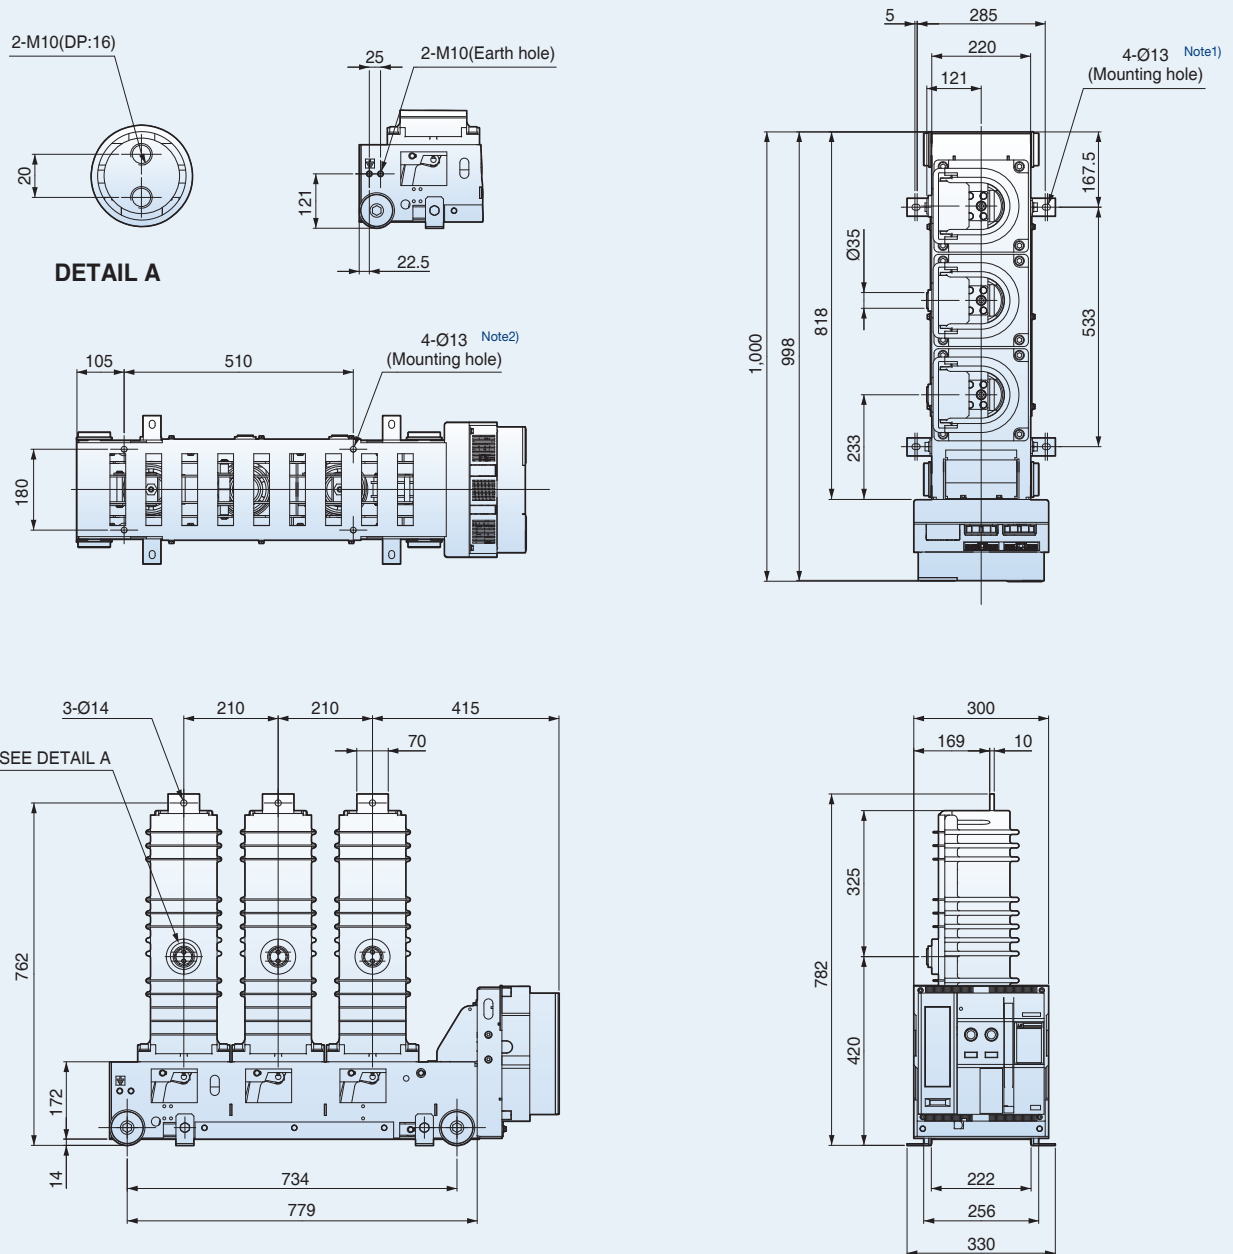






- Note)
1. Mounting hole 01 for compact AIS panel
 2. Mounting hole 02 for using SM VCB only
 3. If using mounting Hole 02, four brackets attached to the frame for mounting hole 01 can be removed.

SM VCB Dimensions

24kV, 25kA, 1250A

Fixed (Left type, phase distance 230mm)

(Unit: mm)

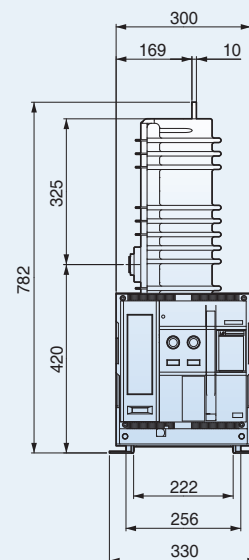
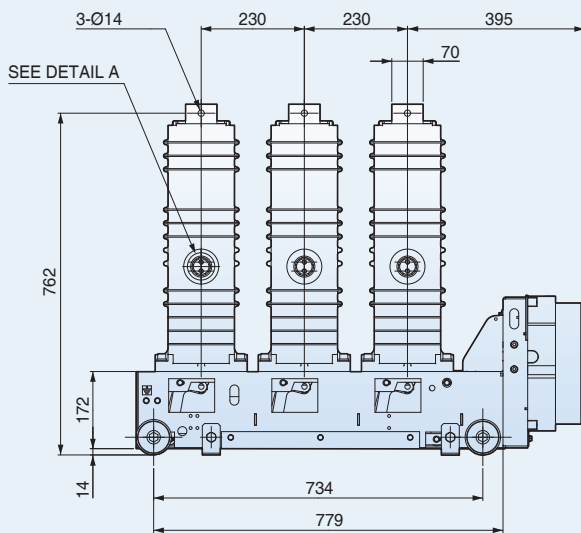
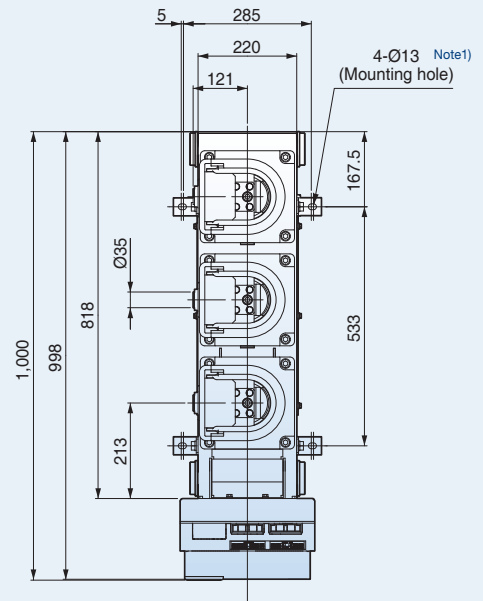
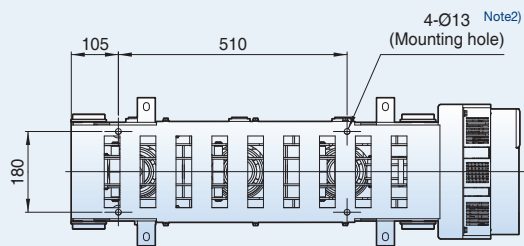
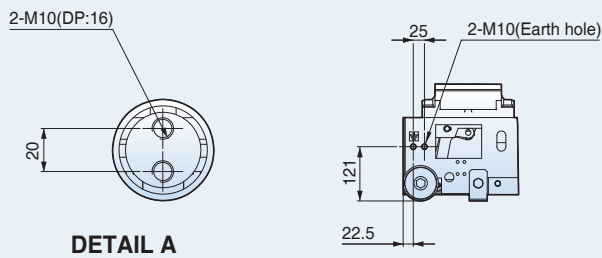


Note)

1. Mounting hole 01 for compact AIS panel
2. Mounting hole 02 for using SM VCB only
3. If using mounting hole 02, four brackets attached to the frame for mounting hole 01 can be removed.

24kV, 25kA, 1250A
Fixed (Left type, phase distance 254mm)

(Unit: mm)

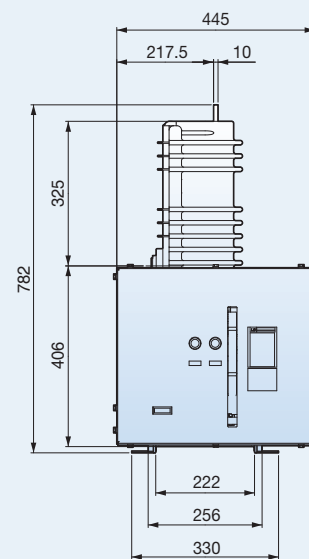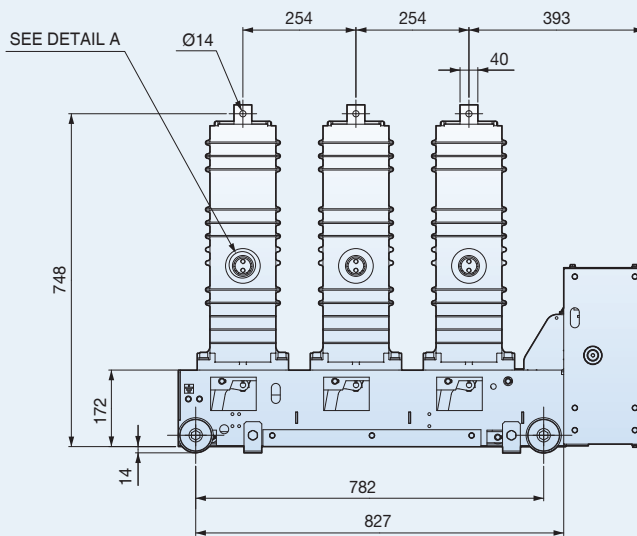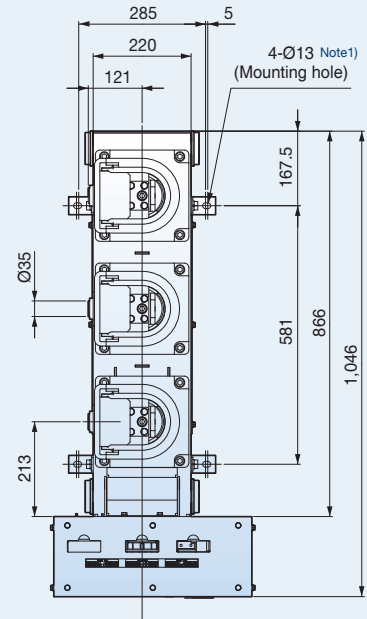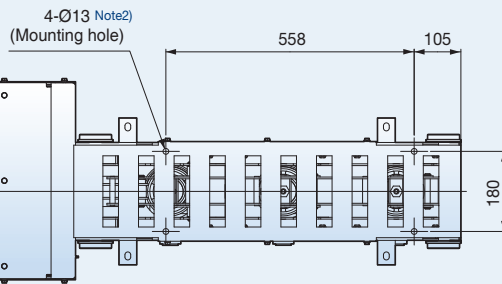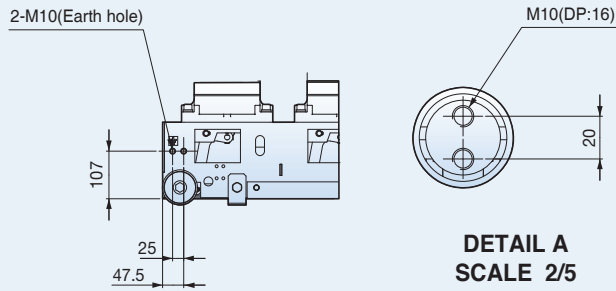


- Note)
1. Mounting hole 01 for compact AIS panel
 2. Mounting hole 02 for using SM VCB only
 3. If using mounting hole 02, four brackets attached to the frame for mounting hole 01 can be removed.


24kV, 25kA, 1250A

Withdrawable (Left type, phase distance 230mm)

(Unit: mm)

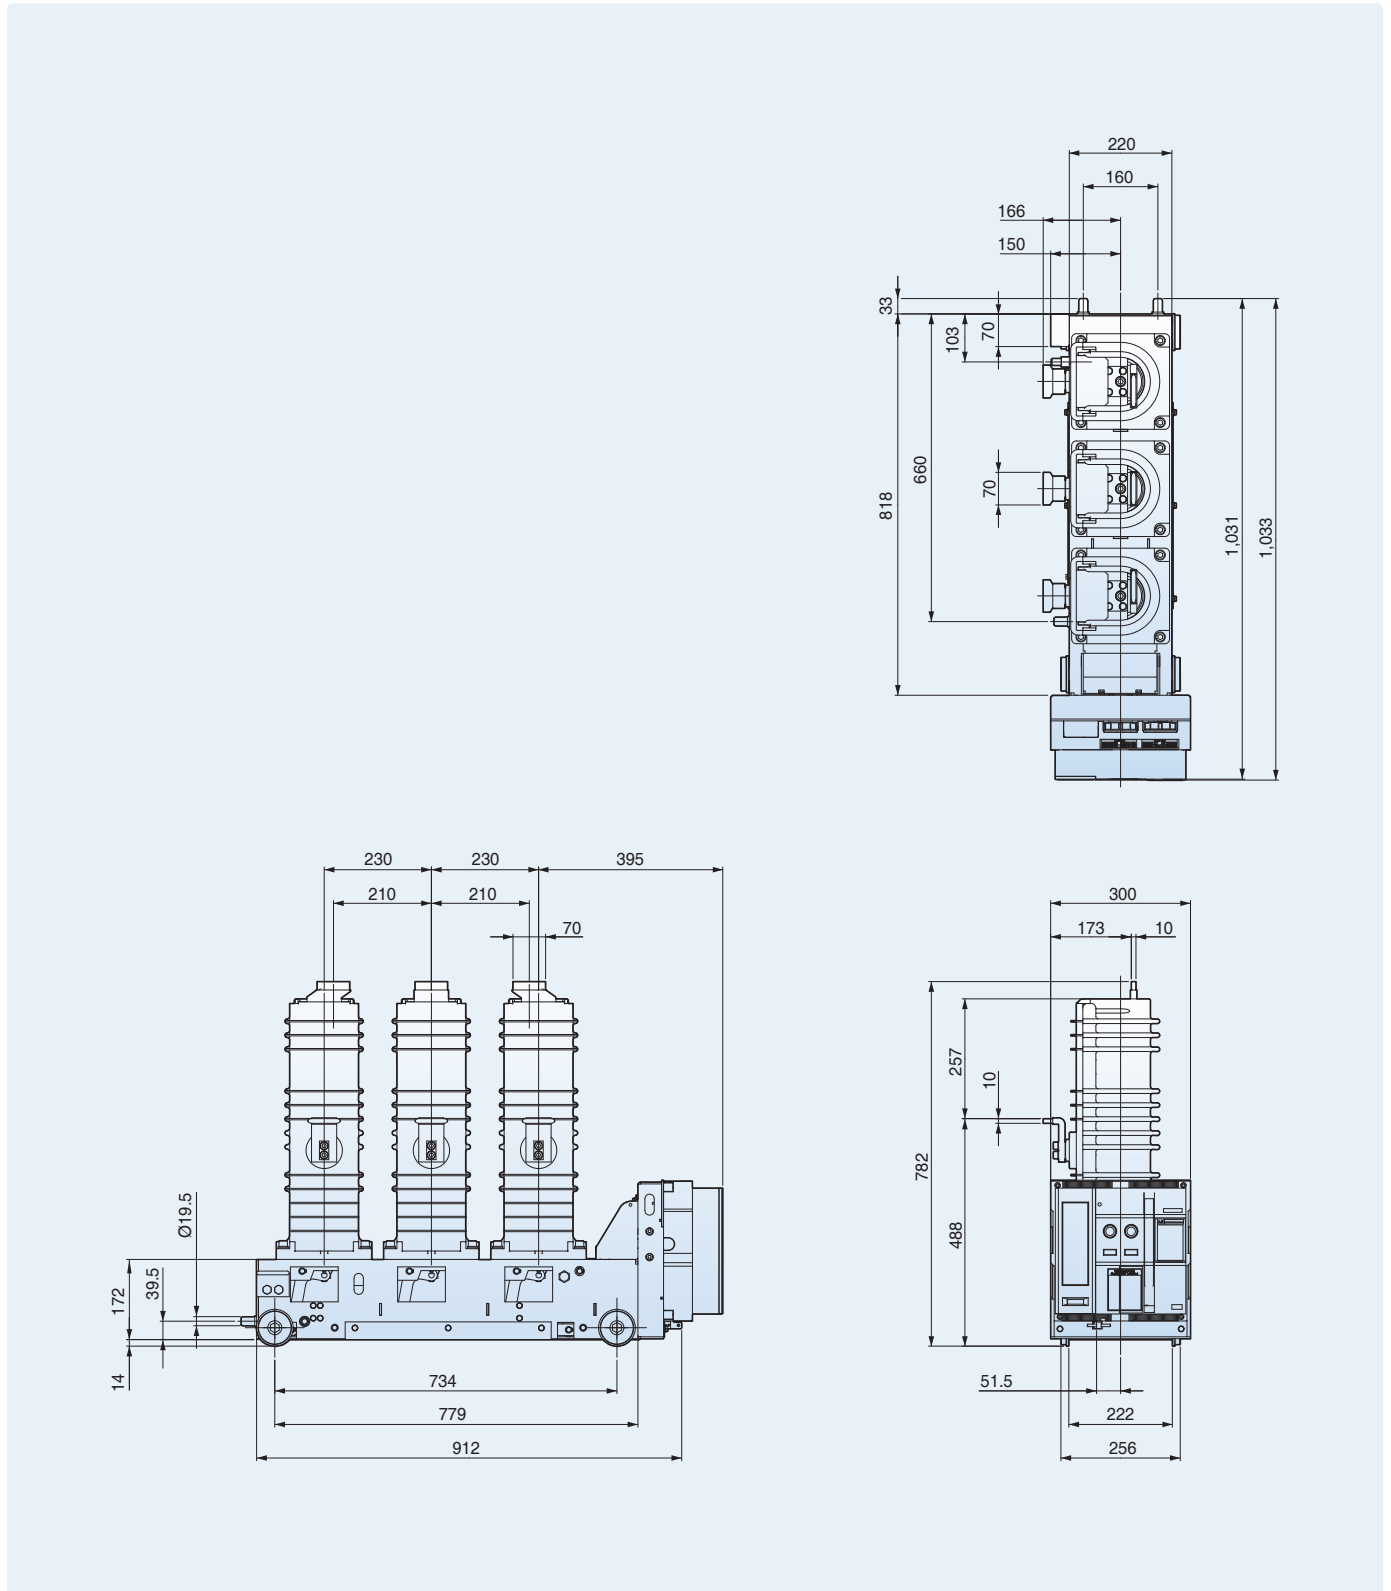

If accessories are attached to the breaker, the function of the breaker is upgraded.
Susol VCB provides a variety of accessories depending on the purpose.

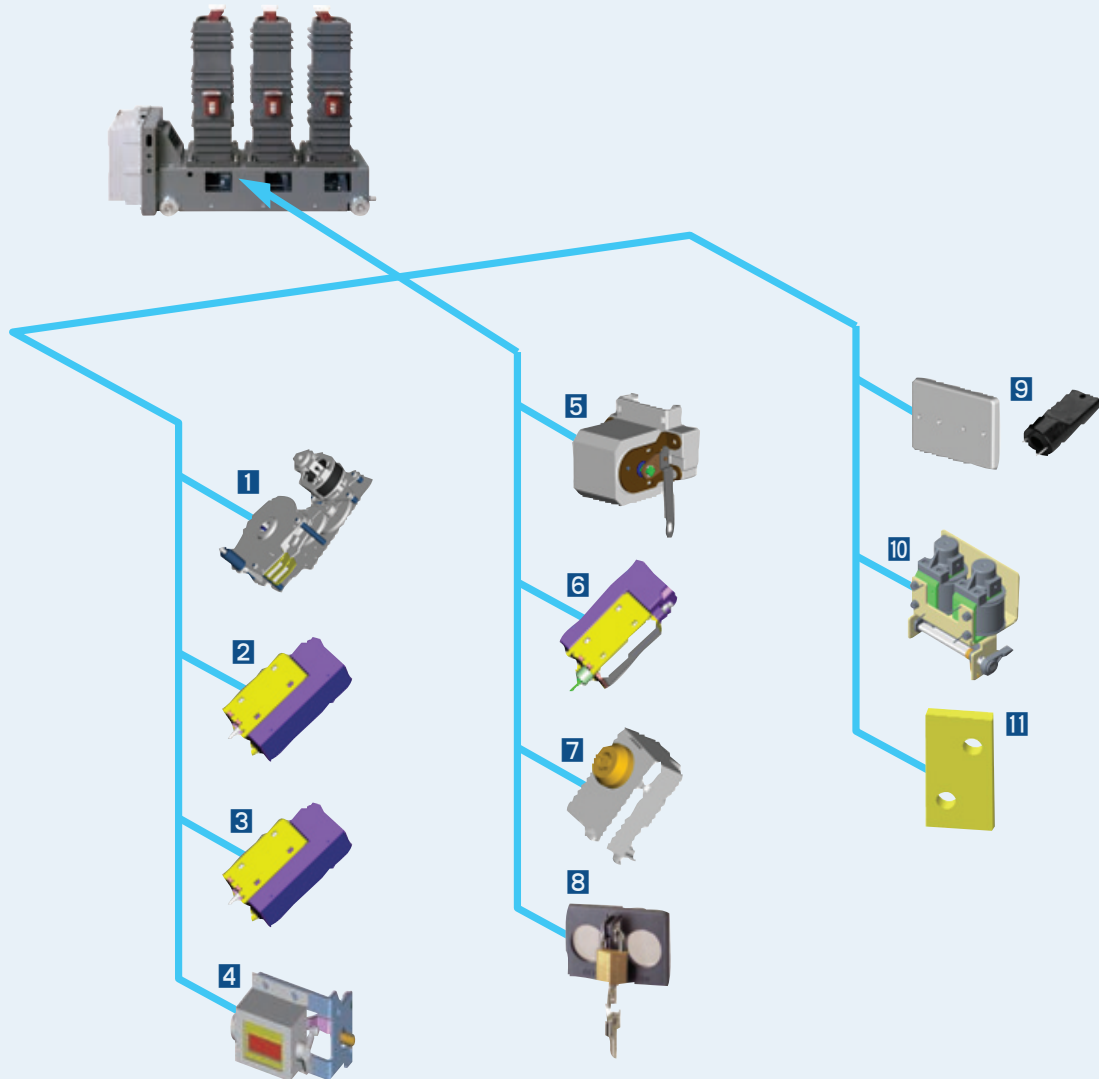

Breaker

- | | |
|----------------------|----------------------------|
| 1 Motor | 7 Keylock |
| 2 Closing coil | 8 Button padlock |
| 3 Trip coil | 9 Button cover |
| 4 Counter | 10 CTC (Current trip coil) |
| 5 Auxiliary contacts | 11 Changeable terminal |
| 6 UVT coil | |



Motor / Closing / Trip

Rated operation and control voltage range

Item		Susol VCB		
		VL: 7.2kV 8/12.5kA	VL: 20/25kA	VH
Motor	AC	85~110%	85~110%	85~110%
	DC	75~110%	85~110%	85~110%
Closing	AC	85~110%	85~110%	85~110%
	DC	75~125%	85~110%	85~110%
Trip	AC	60~125%	85~110%	85~110%
	DC	60~125%	70~110%	70~110%
Applied standards		IEC62271-100 (2008) KSC4611	IEC62271-100 (2008)	IEC62271-100 (2008)

Motor: M

Standard

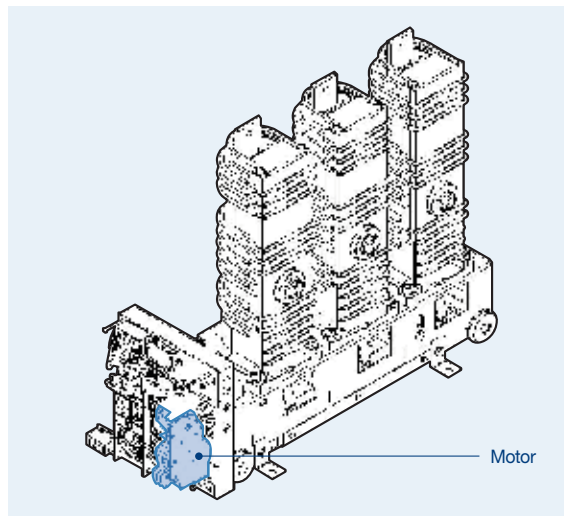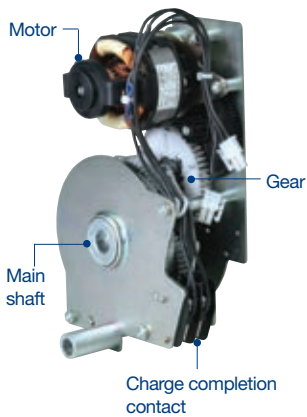


- Charge the closing spring of a circuit breaker by the external power source. When the charging is complete, control power of the motor will be "OFF" by the built-in Limit S/W. Without the external power source, charge manually.

Operating voltage range (IEC 60947)
85%~110%Vn

Input voltage (Vn)	SVL type							
	DC 24~30V	DC 48~60V	DC 110V	DC 125V	DC 220V	AC 48V	AC 100~130V	AC 200~250V
Load current (A)	≤ 5	≤ 3	≤ 1	≤ 1	≤ 0.5	≤ 3	≤ 1	≤ 0.5
Starting current (A)	5 times of load current							
Charge time	Within 5 sec.							

Closing coil: C

Standard

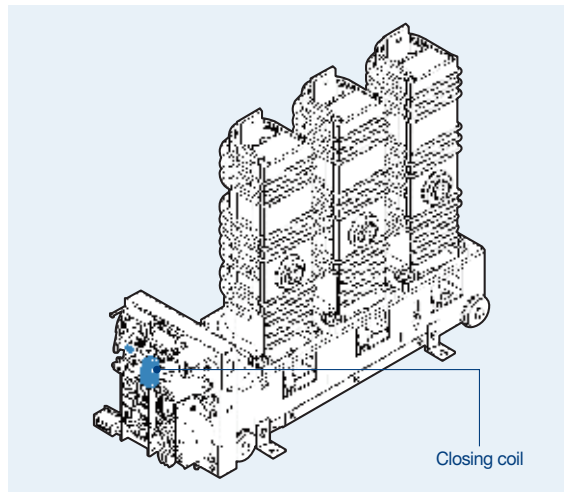


- It is a control device which closes a circuit breaker, when applying voltage continuously or instantaneously over 200ms to the coil control terminals.

Input voltage (Vn)	SVL type							
	DC 24~30V	DC 48~60V	DC 110V	DC 125V	DC 220V	AC 48V	AC 100~130V	AC 200~250V
Power consumption (inrush, W)	200							
Power consumption (steady, W)	≤ 5							

Note) Rated operation and control voltage range, see page 25.

Trip coil: T

Standard

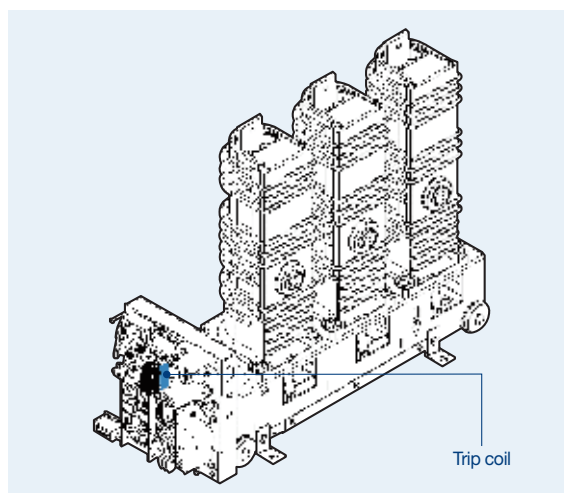


- It is a control device which trips a circuit breaker from remote place, when applying voltage continuously or instantaneously over 35ms to coil control terminals.
- When UVT coil is installed, its location is changed.

Input voltage (Vn)	SVL type							
	DC 24~30V	DC 48~60V	DC 110V	DC 125V	DC 220V	AC 48V	AC 100~130V	AC 200~250V
Power consumption (inrush, W)	200							
Power consumption (steady, W)	≤ 5							

Note) Rated operation and control voltage range, see page 25.

Secondary trip coil: A1

Option

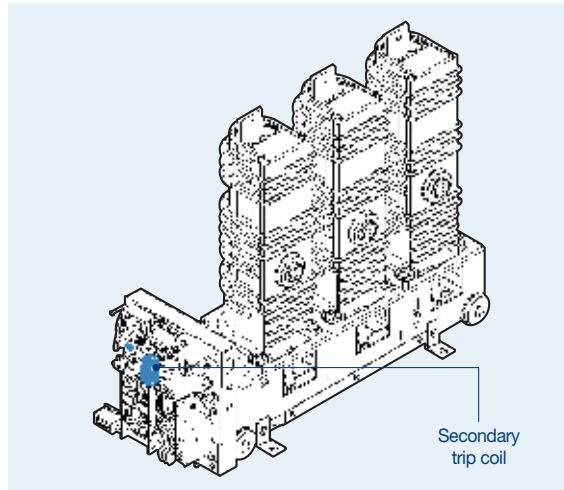


- It is a control device which trips a circuit breaker doubly from the outside. If the trip coil (T) fails, it can trip a circuit breaker safely.
- Trip coil: Install it at existing location.
- Secondary trip coil: Install it on the right side of the trip coil.
- It is not available with UVT coil when installing secondary trip coil.

Input voltage (Vn)	SVL type							
	DC 24~30V	DC 48~60V	DC 110V	DC 125V	DC 220V	AC 48V	AC 100~130V	AC 200~250V
Power consumption (inrush, W)	200							
Power consumption (steady, W)	≤ 5							

Current trip coil: AV, AW

Option

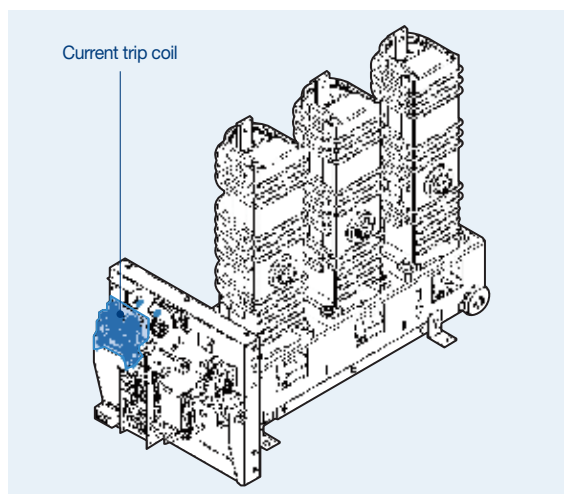


- This trip coil uses the output of the CT as its control power source and is used with over current relay in combination. Two current trip coils are supplied.
- Coil burden is 90VA.(T9)
- Coil impedance(Z) is like below
 - 3A: 10Ω or less, Operating current AC 3A (T9)
 - 1A: 160Ω or less, Operating current AC 1A (AV)
 - 5A: 6Ω or less, Operating current is AC 5A (AW)
- CT must be installed at load side.
If it is installed at bus side there is the danger of malfunction or damage to CT.
- Don't disconnect the control power connector on main power is live condition at service position.
Otherwise there is the danger of malfunction or damage to CT.

* CT is recommended to use 15VA 5P10 and more.


Auxiliary contact: SA

Option

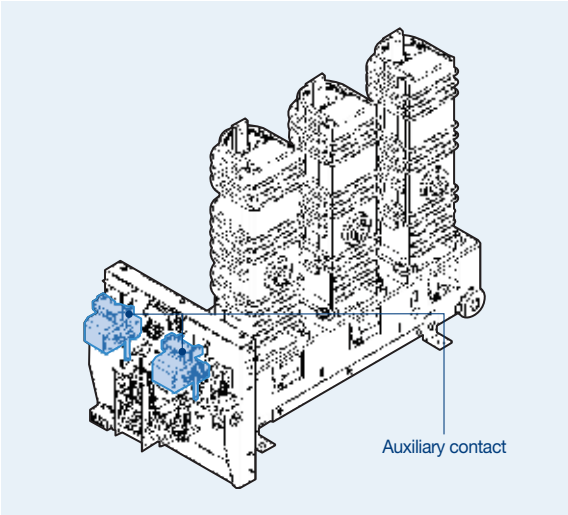

Counter: C

Standard

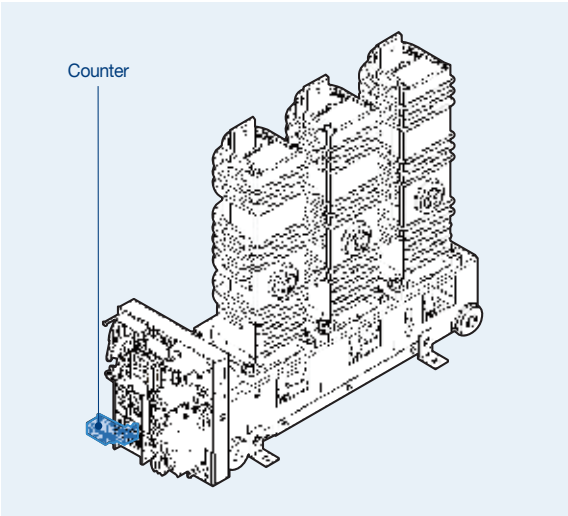


- It displays the total number of ON/OFF operations of a breaker.

Under voltage trip coil: U

Option



VL type

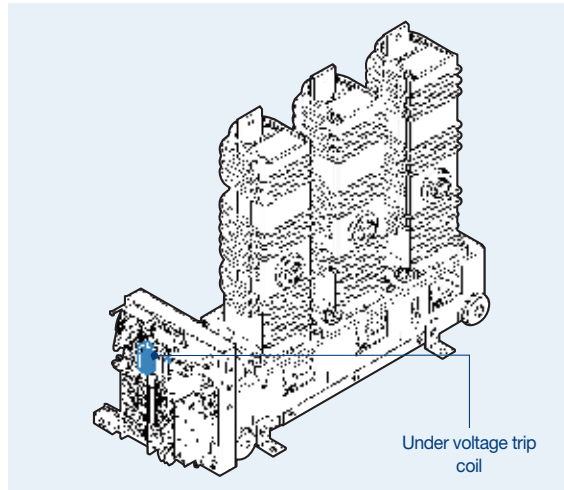

- It is installed inside of a breaker to trip when the main power or control power voltage drops below certain value. Instantaneous type is only available with UVT coil and Time delay type is available by connecting UVT coil and UVT time delay controller.

- The closing of a circuit breaker is impossible mechanically or electrically if control power is not supplied to UVT. To close the circuit breaker, 65~85% of rated voltage should be applied.


- UVT and secondary trip coil will not be selected together.

1. UVT rated voltage and characteristic
 - Operating voltage range: Pick up 0.65~0.85Vn, Drop out 0.4~0.6Vn
 - Operating voltage ranges based on the minimum value of each rated voltage (Vn)

Input voltage (Vn)	SVL type							
	DC 24~30V	DC 48~60V	DC 110V	DC 125V	DC 220V	AC 48V	AC 100~130V	AC 200~250V
Power consumption (inrush, W)	200							
Power consumption (steady, W)	≤ 5							

Keylock: A7

Option

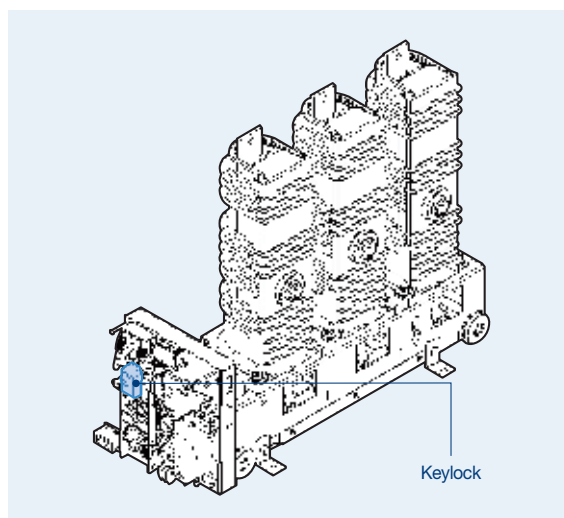


- The key is to unlock the locking device first to close the breaker electrically and mechanically.

*How to operate

- It is not possible to pull out the key in the unlocked position, possible only in locked status.
- Pushing "OFF" switch of a breaker turn the key counter-clockwise to the locked position and pull it out.
- It is not possible to close the breaker electrically and mechanically in the locked position.
- Insert the key and turn clockwise and then the breaker can be closed electrically and mechanically.

Button padlock: A8

Option

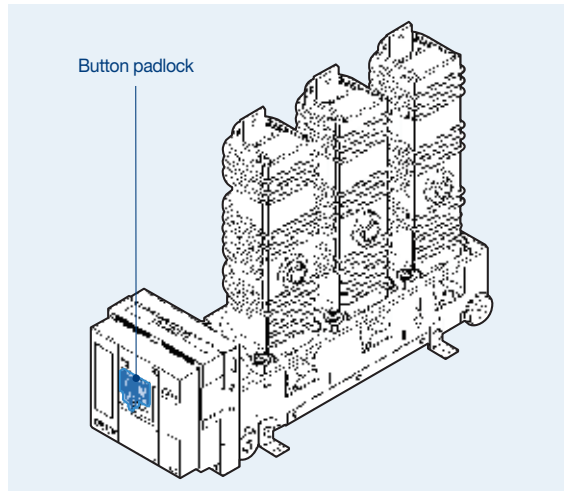


- It is to prevent manual operation of ON/OFF button due to user's wrong handling.
- It is not possible to handle ON/OFF operation under the "Button lock" status.

* Key lock is not supplied.

Button cover: A9

Option

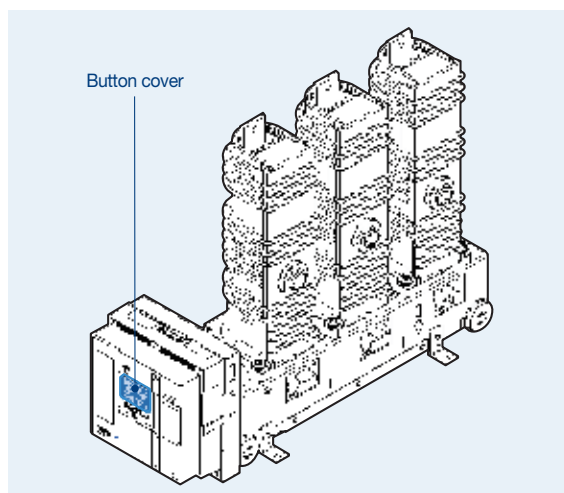

- It is a protection cover to prevent an accident due to unintended operation of ON/OFF button.
- Use the push-bar to operate the ON/OFF button.

Lead wire: AA

Option



- It is the connect with the control circuit of a breaker from outside. (supply wire length: 2m)

A type connector

Plug/terminal for lead wire: AB

Option




- It is connector to connect with the connector installed in the breaker. (supply connectors and terminal only for lead wire)

A type connector

Changeable terminal (210 ↔ 230)

- It is an additional terminal attached to the upper terminal and is used to change the Phase distance 210→230.
- The order can be proceeded with the terminal box code and 30 terminals are packed in one box.

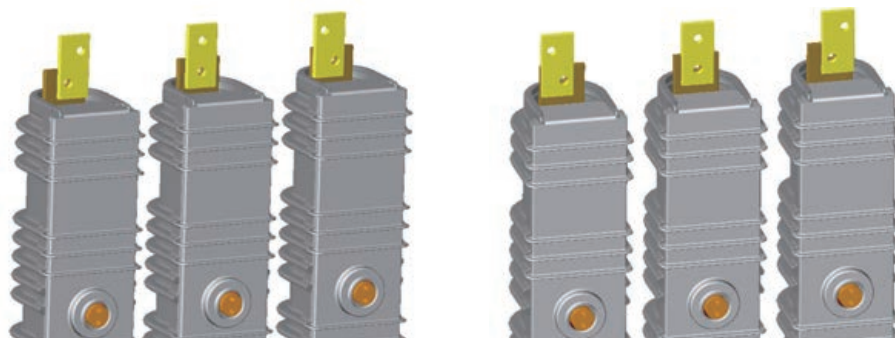


230 → 210

210 → 230

SM LBS

Switch with safety and convenience of maintenance cost

SM LBS (Side mount LBS)

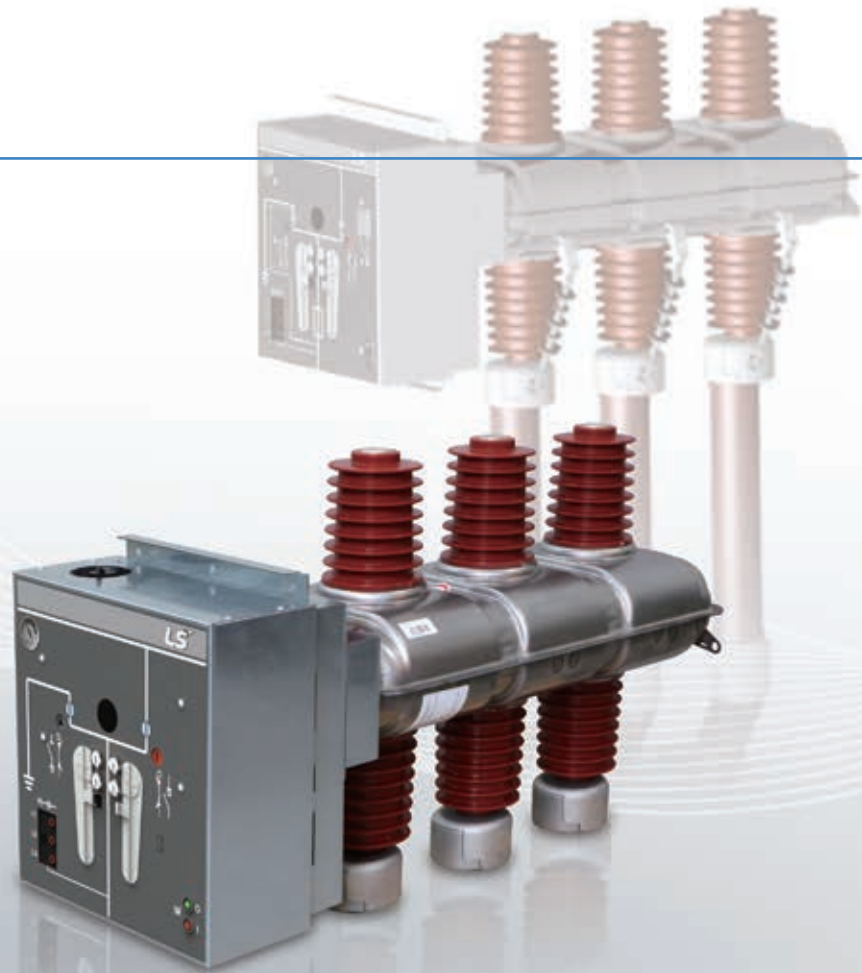

Insulation level			Indoor
Rated voltage		(kV)	12 / 17.5 / 24
Rated current	Cable switch, Busbar	(A)	630
	Circuit breaker	(A)	630 / 1250
Rated frequency		(Hz)	50 / 60
Rated short-time withstand current		(kA/3s)	21 (25kA/1s)
Power frequency withstand voltage	Between ground and phase	(kV/1min.)	28 / 38 / 50
	Between the open contact of the switch disconnecter	(kV/1.2 × 50 μ s)	32 / 45 / 60
Impulse withstand voltage	Between ground and phase	(kV/1min.)	75 / 95 / 125
	Between the open contact of the switch disconnecter	(kV/1.2 × 50 μ s)	85 / 110 / 145
Operation method	LBS Switch / Fuse		Manual / Motor (Option)
	ES		Manual
Motor operating voltage		(V)	AC/DC 110/230, DC 24, DC48
Insulation method			SF ₆ Gas
Electrical durability	LBS		E3
	Internal ES		E1
Mechanical durability	LBS		M1
	Internal ES		M0
Standard			IEC 62271-1, 102, 103, 105

Types and ordering information

LS	AG	24	21	06	FU
Basic type	Installation	Rated voltage	Rated short-time current	Rated current	Frontal cover type
LS LS SM switch	AG Air Gas	12 12kV 17 17.5kV 24 24kV	16 16kA/3s 21 21kA/3s	06 630A	FU F-LBS FU PU F-LBS PU (EXT) LU LBS LU CA LBS CU-A CW LBS CU-W SL LBS SU-Left SR LBS SU-Right
LF LS SM fuse combination switch					


S	M	D	23	PG	VD	AMF	KM	T1	BT
Operation method	Operation method	Operation voltage	Operation voltage	Voltage presence system	Voltage presence system	Key lock	Key lock	Opening push button	Opening push button
S LS SM switch F LS SM fuse combination switch	H Handle M Motor	02 24V 04 48V 11 110V 23 230V XX None	02 24V 04 48V 11 110V 23 230V XX None	VD Voltage presence system VX None	VD Voltage presence system VX None	KM Open & close for main KE Open & close for E/S KA Open & close for main, E/S KX None	KM Open & close for main KE Open & close for E/S KA Open & close for main, E/S KX None	BT Opening push button for fuse switch only BX None	BT Opening push button for fuse switch only BX None
	Operation power	Gas gauge	Gas gauge	Auxiliary contact	Auxiliary contact	Trip coil	Trip coil		
	D DC A AC X None	PG Pressure gauge PX None	PG Pressure gauge PX None	AMS 2NO+2NC for main AES 2NO+2NC for E/S AAS 2NO+2NC for main & E/S AMF 2NO+2NC for main & 1NO+1NC blowing fuse condition AEF 2NO+2NC for E/S & 1NO+1NC blowing fuse condition AAF 2NO+2NC for main & E/S & 1NO+1NC blowing fuse condition AFF 1NO+1NC blowing fuse condition AXX None	AMS 2NO+2NC for main AES 2NO+2NC for E/S AAS 2NO+2NC for main & E/S AMF 2NO+2NC for main & 1NO+1NC blowing fuse condition AEF 2NO+2NC for E/S & 1NO+1NC blowing fuse condition AAF 2NO+2NC for main & E/S & 1NO+1NC blowing fuse condition AFF 1NO+1NC blowing fuse condition AXX None	T1 Trip coil 110 Vdc for fuse switch only T2 Trip coil 24 Vdc for fuse switch only TX None	T1 Trip coil 110 Vdc for fuse switch only T2 Trip coil 24 Vdc for fuse switch only TX None		

LS type 4Vdc-48Vdc



Characteristics of components

SF₆ disconnecting unit is equipped with switch disconnector and earthing switch fitted with separated and interlocked operating mechanism.

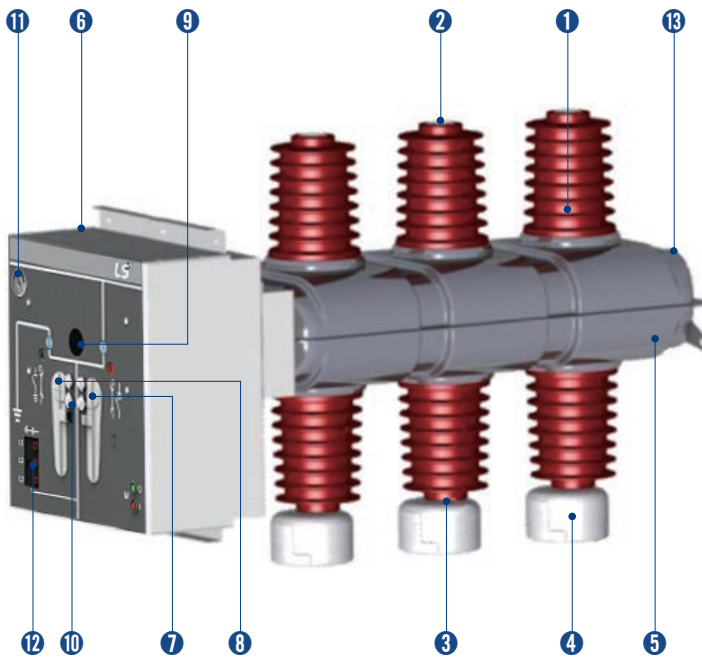

- ① Insulator
- ② Upper terminal
- ③ Lower terminal
- ④ Electrical field adapter only for 24kV
- ⑤ Stainless steel body
- ⑥ Operating mechanisms box
- ⑦ Switch-disconnector operating seat
- ⑧ Earthing-switch operating seat
- ⑨ Inspection window
- ⑩ Key interlock
- ⑪ Manometer
- ⑫ Voltage signalling lamp
- ⑬ Safety valve


LF type 4Vdc-48Vdc



Characteristics of components

Structurally, F-LBS is similar to LBS switch disconnector but it is equipped with fuse-holder and downstream fuses air insulated earthing switch and release system activated by fuse striker and shunt-trip coil (optional).



F-LBS is equipped with switch-disconnector and earthing switch fitted with separated and inter locked operating mechanism.

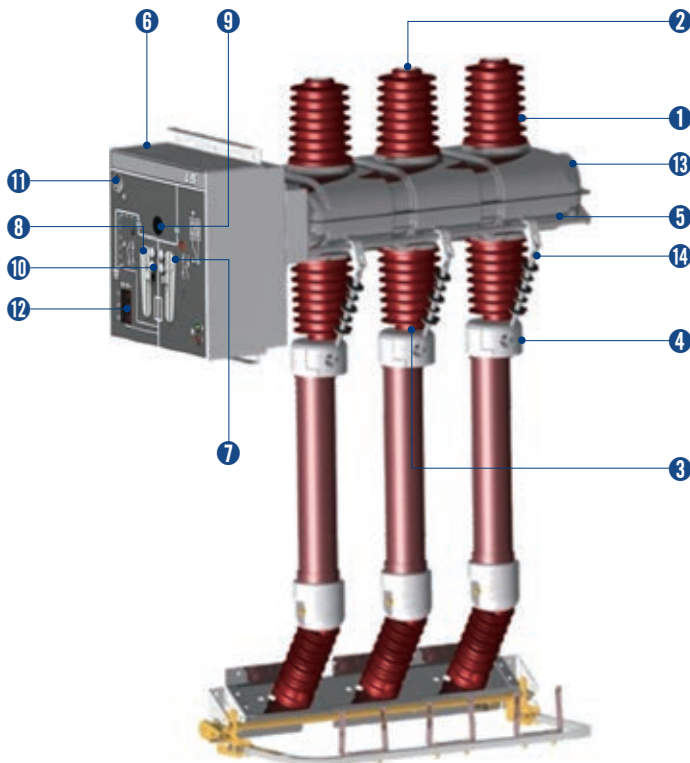

- ① Insulator
- ② Upper terminal
- ③ Lower terminal
- ④ Electrical field adapter only for 24kV
- ⑤ Stainless steel body
- ⑥ Operating mechanisms box
- ⑦ Switch-disconnector operating seat
- ⑧ Earthing-switch operating seat
- ⑨ Inspection window
- ⑩ Key interlock
- ⑪ Manometer
- ⑫ Voltage signalling lamp
- ⑬ Safety valve
- ⑭ Fuse striker link
- ⑮ External earthing switch
- ⑯ Fuse link

SM LBS Control circuit diagram


LS type 24Vdc-48Vdc

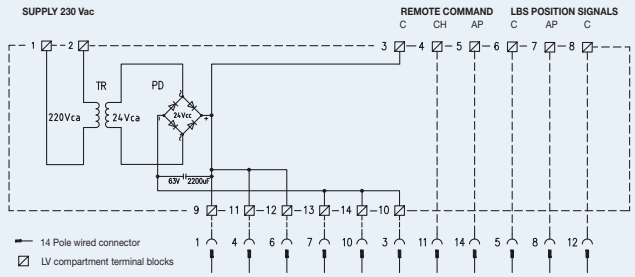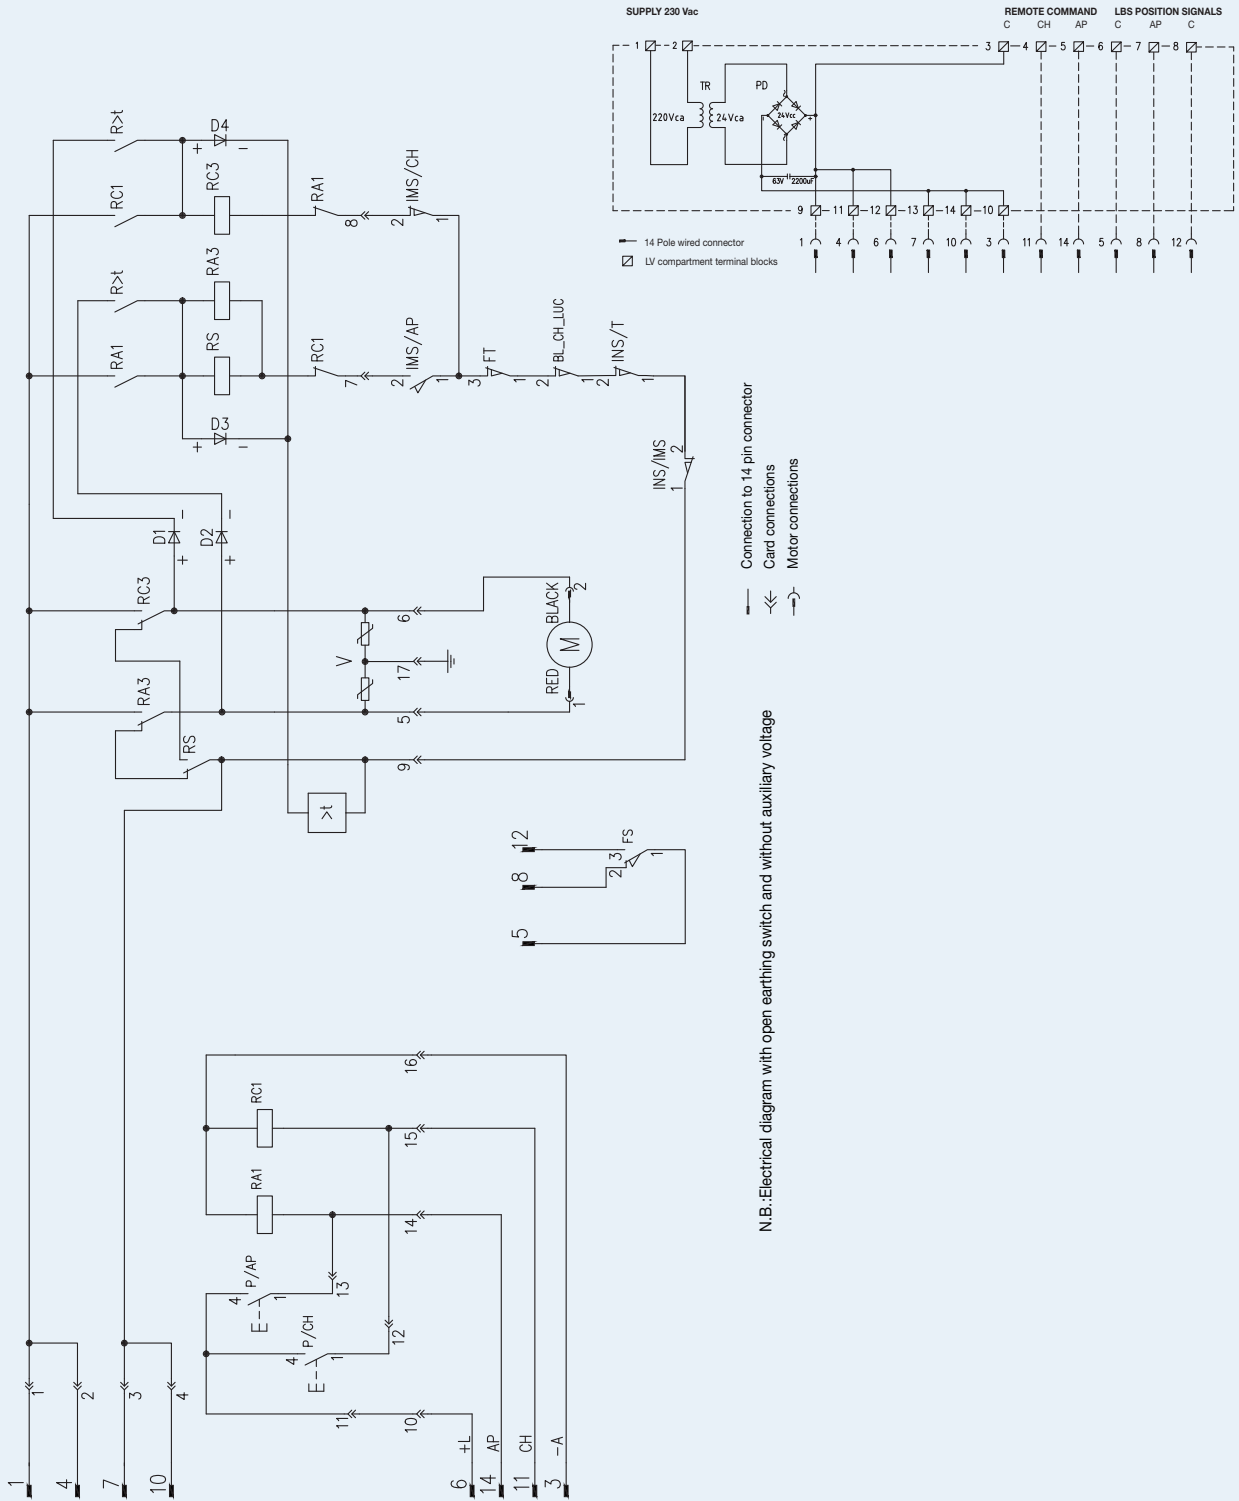


— Connection to 14 pin connector
 ◀ Card connections
 → Motor connections

N.B.: Electrical diagram with open earthing switch and without auxiliary voltage

LS type 110Vdc

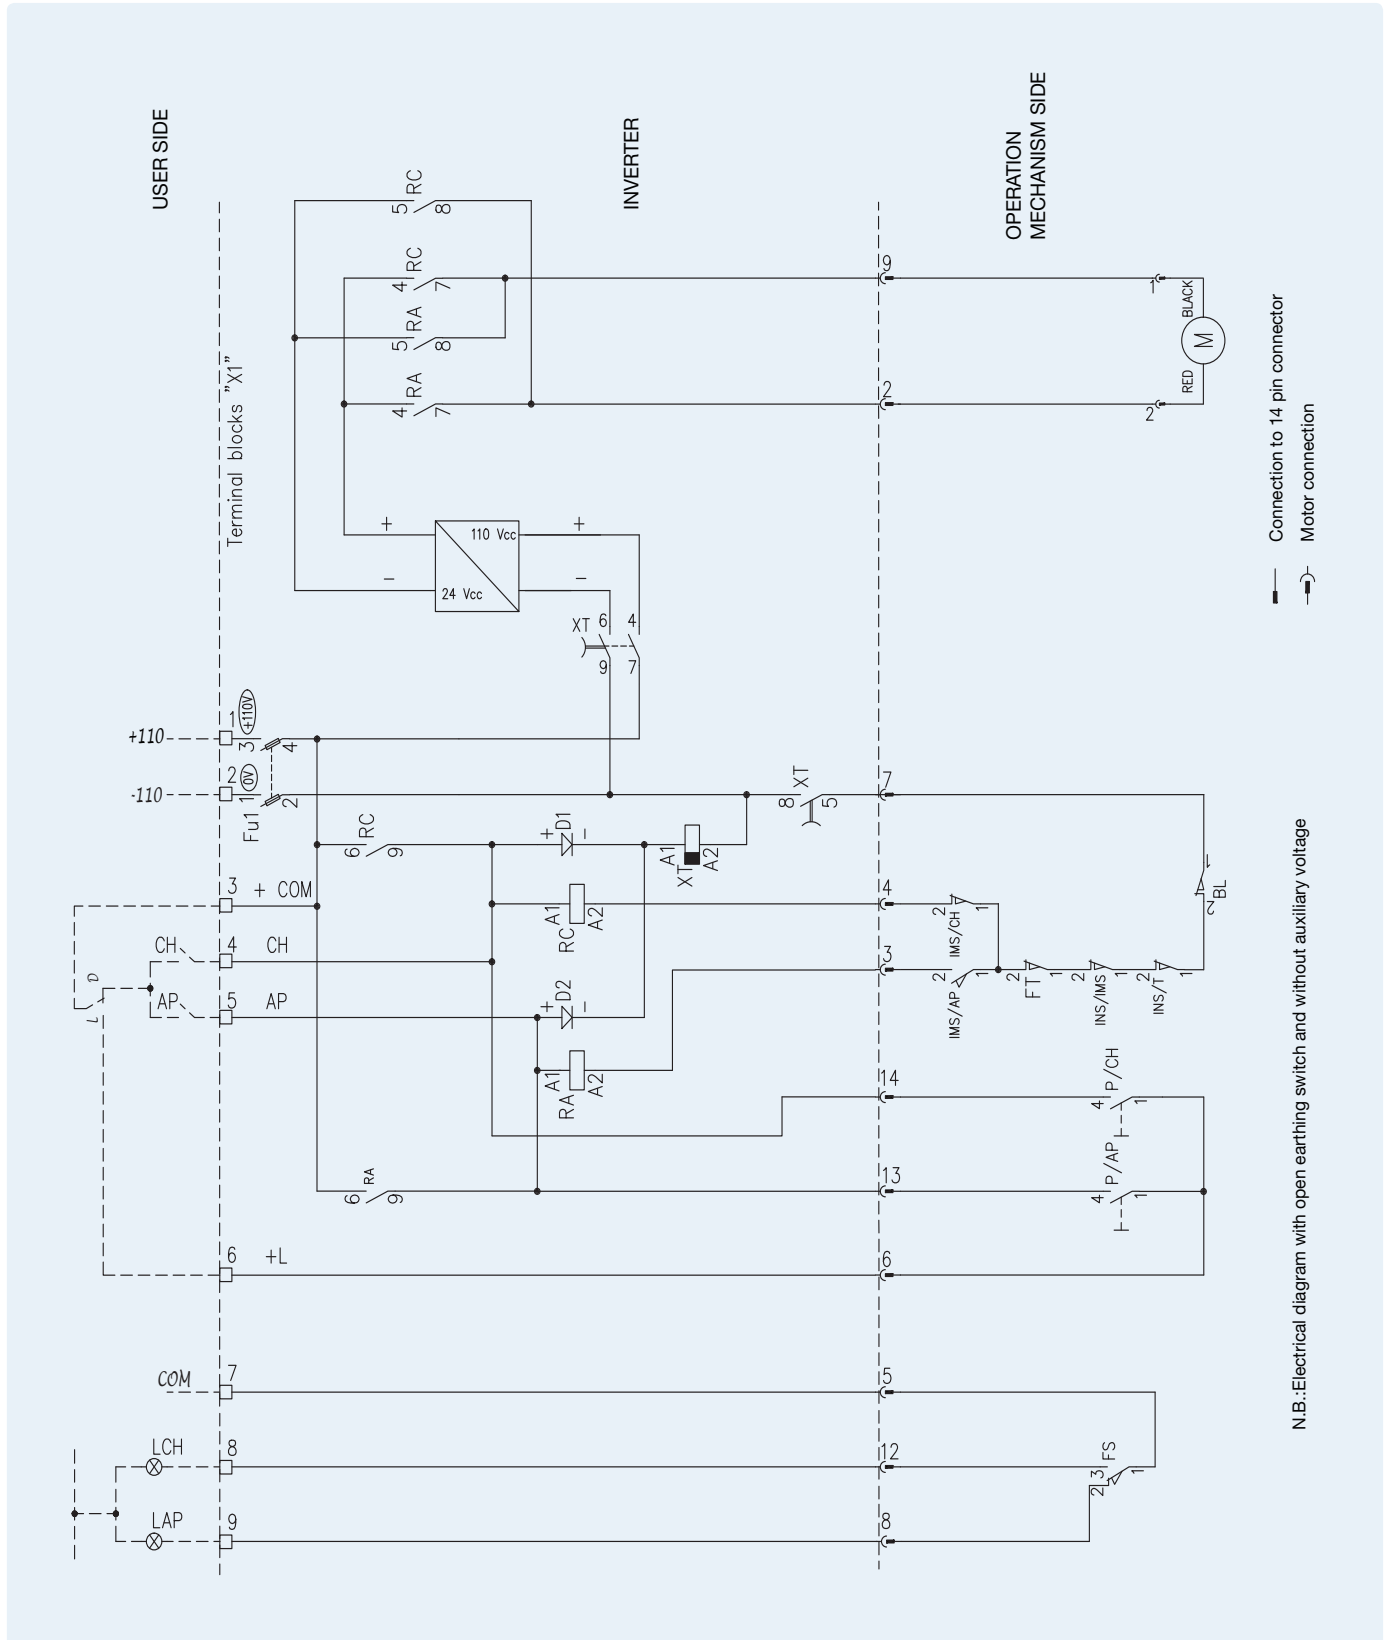


LF type 110Vdc

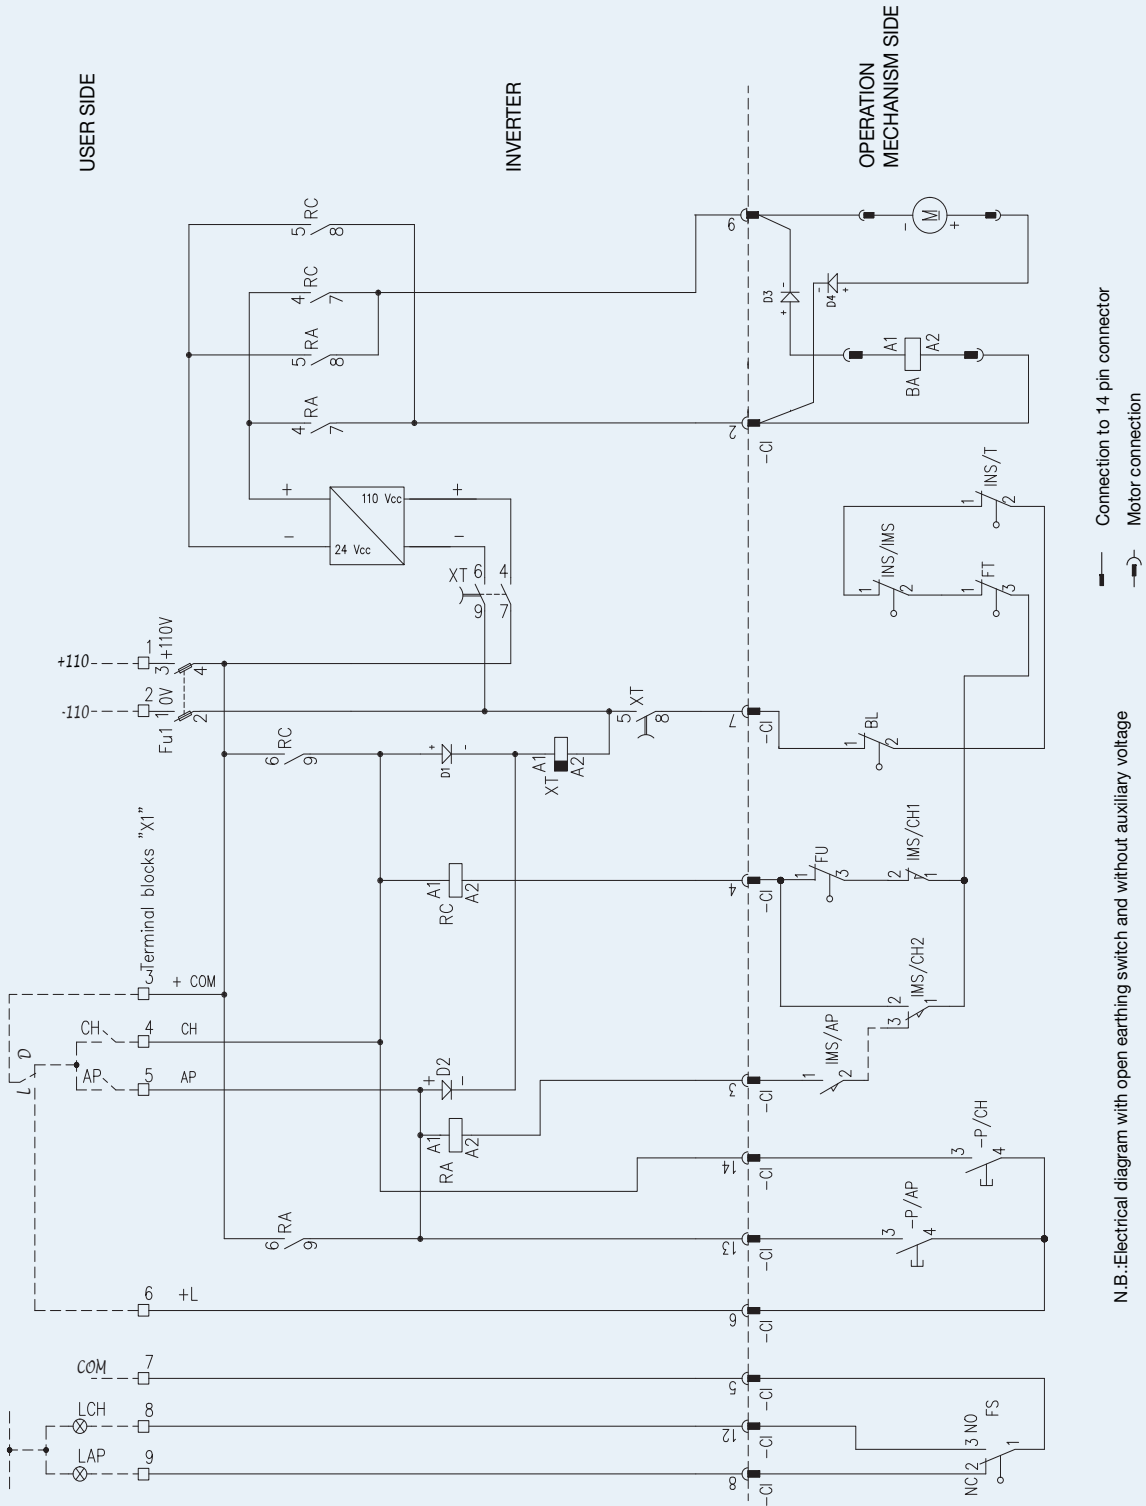

SM LBS Dimensions


LS type 24kV, 21kA, 630A

(Unit: mm)

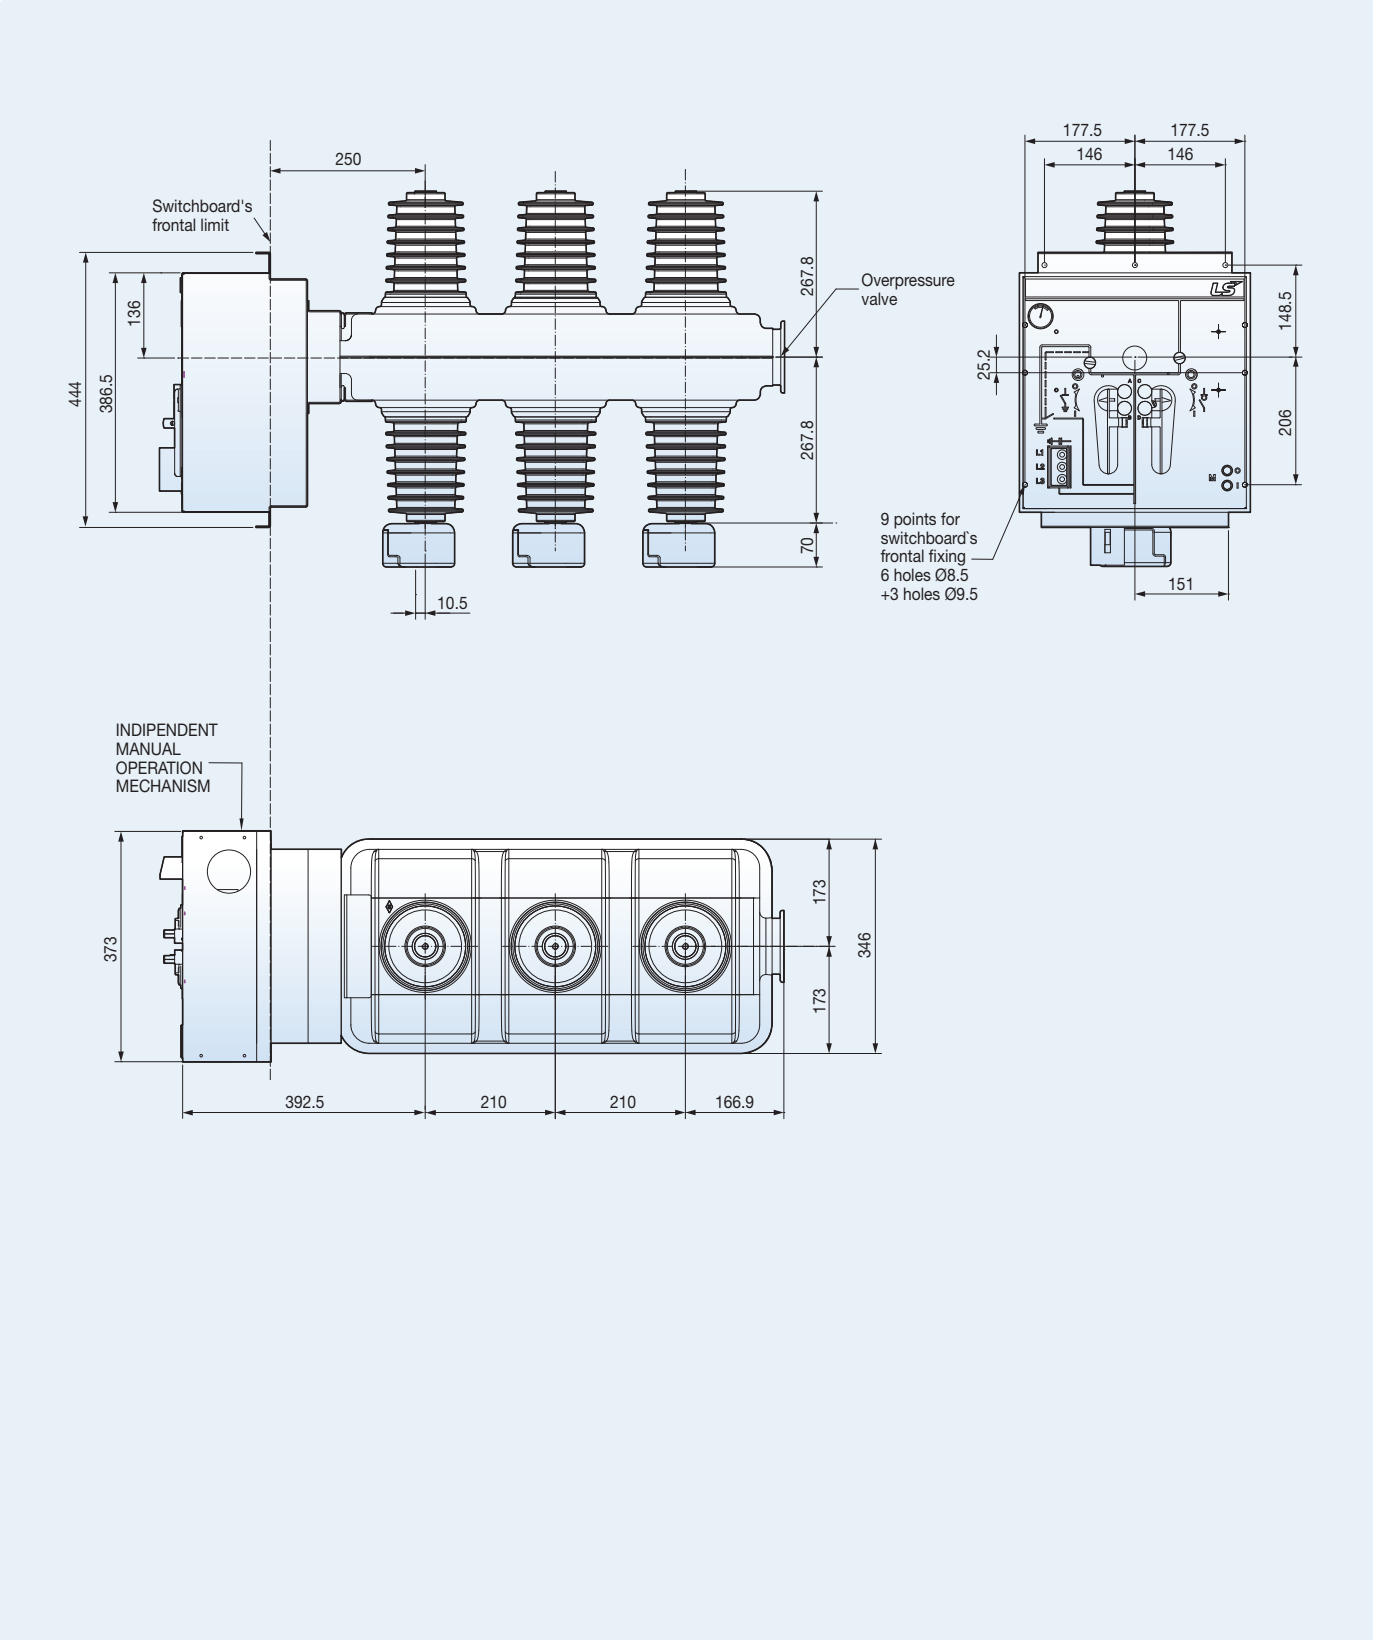

LF type 24kV, 21kA, 630A

(Unit: mm)

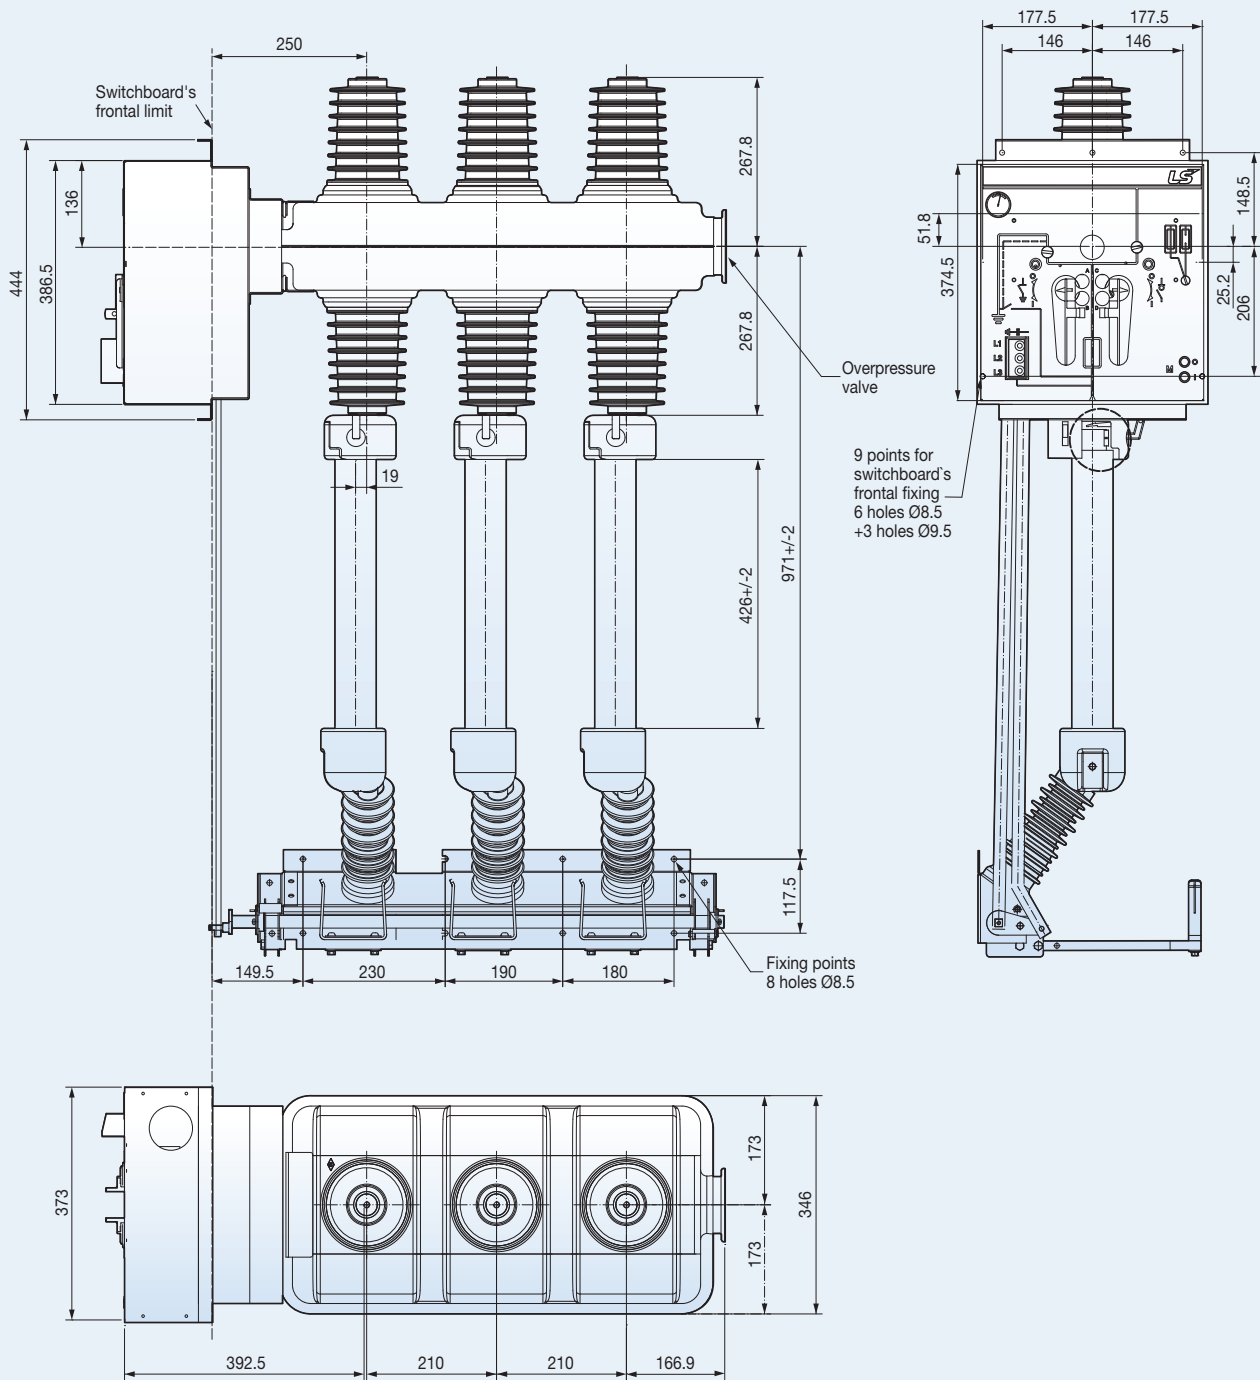


Options for Compact AIS

Current transformer (WS-261[W][R])



Section		Contents			
Highest voltage for equipment	kV	7.2	12	17.5	24
Rated power frequency withstand voltage (1min)	kV	20	28	38	50
Rated lightning impulse withstand voltage	kV	60	75	95	125
Rated frequency	Hz	50 or 60			
Rated primary current	A	30 to 600			
Rated continuous thermal current	X In	1.2			
Rated secondary current	A	5 or 1			
Rated short-time thermal current Ith (1sec)	max.kA	50			
Rated dynamic current Idyn (2.5×Ith)	max.kA	125			
Number of cores	max.	2			
Weight (approx.)	kg	48			
Applying Standards		IEC 61869-2, IEEE C57.13, KS C 1706, JEC 1201			
Model designation		WS-261			

Voltage transformer (PE-28N)



Technical Data				
Highest voltage for equipment	kV	12	17.5	24
Rated power frequency withstand voltage (1min)	kV	28	38	50
Rated lightning impulse withstand voltage	kV	75	95	125
Rated frequency	Hz	50 or 60	50 or 60	50 or 60
Rated primary voltage	V	11000√3	13800√3	22000√3
Rated secondary voltage	V	110√3	110√3	110√3
Rated voltage factor/cont		1.9/8h	1.9/8h	1.9/8h
Rated burden	VA	50	50	50
Weight (approx.)	kg	38	38	38
Applying Standards		IEC 61869-3, IEEE C57.13, KS C 1706, JEC 1201		
Model designation		PE-28N		

Voltage detector (VDS)



Voltage detector is used to verify the presence ("Voltage Present") and absence ("No Voltage Present") condition in medium voltage switchgears, electrical equipment or of work places when working under voltage.

Power fuse (SIBA)



Fuse ratings for C-AIS units mainly depend on the following criteria.

- 1) Service voltage
- 2) Transformer rating
- 3) Fuse technology (maker)

Rated voltage	Article	Rated current	Length	Diameter
kV	-	A	mm	Mm
10/24	30 006 13	6,3 ~ 40	442	53
	30 014 13	50 ~ 63		67



XGIPAM

XGIPAM is the digital integrated protection & monitoring device solution for more convenient and reliable power protection and monitoring system through the easy interface, user friendly, high accuracy and high reliability.

- Protection function - 50/51, 50/51N, 67G, 67N, 59, 27, 64, 47, 46, 49, 48/51LR, 79, 87T, 37, 66
- 8.4 inch large touch screen color TFT LCD
- System MIMIC diagram
- Modular design of H/W and S/W with flexibility
- Setting for the secondary rating of PT: 110 or $110 / \sqrt{3}$
- Wave capture available
- Waveform recording for the state changes of equipment
- Dedicated PC manager program supported
- Supporting dual independent systems through two built-in communication ports
- 0.2% of the voltage and current measurement accuracy



GIPAM2000

GIPAM2000 is a digital integrated protection & monitoring device and monitoring device providing various protective elements and measurement elements for fault monitoring and protection and comprehensive monitoring of the distribution equipments.

- Protection function - 50/51, 50/51N, 67G, 67N, 59, 27, 64, 47, 46, 49, 48/51LR, 79, 87T
- Covering PLC (Programmable logic controller) functions
- 320×240 Graphic LCD & MIMIC diagram
- SOE (Sequence of event) function
- Recording event & fault functions
- Displaying harmonic spectrum, THD (Total harmonic distortion)
- Combination of the two elements of characteristic curve of the relay should be available
- Power and current demand should be measured

GIPAM10

GIPAM10 series provide accurate measurement and monitoring information necessary for efficient maintenance and post-fault analysis.



- Protection function - 50/51, 50/51N, 46, 79, 59, 27, 47P, 64, 67G, 67N
- Communication: Modbus
- Wave / fault / event recording
- DO latch function, trip DO and alarm DO setting
- Available to set up setting group up to 3 (GIPAM 10CU/10CR)
- Wave / fault / event recording

Order form

Compact AIS - LU (Load break switch unit)

Basic cubicle				Quantity	<input type="text"/>
Rated voltage, Ur	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>		
Service voltage				(kV)	<input type="text"/>
Short-circuit current, I _{sc}				(kA)	<input type="text"/>
Rated current, I _r				(A)	<input type="text"/>
Internal arc withstand	None <input type="checkbox"/>	21kA/1s <input type="checkbox"/>	A-FLR <input type="checkbox"/>		
Position in the switchboard	First on left <input type="checkbox"/>	Middle <input type="checkbox"/>	Last on right <input type="checkbox"/>		

Option					
Electrical driving motorization	24 Vdc <input type="checkbox"/>	48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/>	220 Vac <input type="checkbox"/>
Auxiliary contacts 2NO+2NC main					<input type="text"/>
Auxiliary contacts 2NO+2NC E/S					<input type="text"/>
Key lock	LBS Open <input type="checkbox"/>	LBS Close <input type="checkbox"/>	E/S Open <input type="checkbox"/>	E/S Close <input type="checkbox"/>	
Pressure gauge	None <input type="checkbox"/>	Presence <input checked="" type="checkbox"/>	(Selection recommended)		
Voltage detection system	None <input type="checkbox"/>	Presence <input type="checkbox"/>			
Control voltage (Including lamp)	24 Vdc <input type="checkbox"/>	48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/>	220 Vac <input type="checkbox"/>
Low voltage control cabinet	Default only <input type="checkbox"/>	Add. top <input type="checkbox"/>			
Heater with thermostat	50W <input type="checkbox"/>	100W <input type="checkbox"/>			
Surge arrester (Width 500)	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>		

Order form

Compact AIS - PU (Voltage transformer unit)

Basic cubicle				Quantity <input type="text"/>
Rated voltage, Ur	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>	
Service voltage				(kV) <input type="text"/>
Short-circuit current, I_{sc}				(kA) <input type="text"/>
Rated current, I_r				(A) <input type="text"/>
Internal arc withstand	None <input type="checkbox"/>	21kA/1s <input type="checkbox"/>	A-FLR <input type="checkbox"/>	
Position in the switchboard	First on left <input type="checkbox"/>	Middle <input type="checkbox"/>	Last on right <input type="checkbox"/>	
VT				See p.44

Option				
Fuses				(A) <input type="text"/>
Electrical driving motorization	24 Vdc <input type="checkbox"/> 48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/> 220 Vac <input type="checkbox"/>	
Auxiliary contacts 2NO+2NC main				<input type="text"/>
Auxiliary contacts 2NO+2NC E/S				<input type="text"/>
Blown fuse signalling contact				<input type="text"/>
Key lock	LBS Open <input type="checkbox"/> LBS Close <input type="checkbox"/>		E/S Open <input type="checkbox"/> E/S Close <input type="checkbox"/>	
Pressure gauge	None <input type="checkbox"/>	Presence <input checked="" type="checkbox"/>		(Selection recommended)
Control voltage (Including lamp)	24 Vdc <input type="checkbox"/> 48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/> 220 Vac <input type="checkbox"/>	
Low voltage control cabinet	Default only <input type="checkbox"/>	Add. top <input type="checkbox"/>		
Heater with thermostat	50W <input type="checkbox"/>	100W <input type="checkbox"/>		

Compact AIS - CU-A/CU-W (Circuit breaker unit)

Basic cubicle				Quantity <input type="text"/>
Rated voltage, Ur	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>	
Service voltage				(kV) <input type="text"/>
Short-circuit current, I_{sc}				(kA) <input type="text"/>
Rated current, I_r				(A) <input type="text"/>
Internal arc withstand	None <input type="checkbox"/>	21kA/1s <input type="checkbox"/>	A-FLR <input type="checkbox"/>	
Position in the switchboard	First on left <input type="checkbox"/>	Middle <input type="checkbox"/>	Last on right <input type="checkbox"/>	
Vacuum circuit breaker type	Fixed <input type="checkbox"/>	Withdrawable <input type="checkbox"/>		
CT				See p.44
Protection relay	Gipam 10 <input type="checkbox"/>	Gipam 2000 <input type="checkbox"/>	X-Gipam <input type="checkbox"/>	For others, discussion is needed.
Earthing switch at cable side	E0 <input type="checkbox"/> Lock Coil <input type="checkbox"/>	E1 <input type="checkbox"/> VD <input type="checkbox"/>	4a4b <input checked="" type="checkbox"/>	(Short-circuit making capacity) (4a4b contact is default.)

Option				
Electrical driving motorization	24 Vdc <input type="checkbox"/> 48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/> 220 Vac <input type="checkbox"/>	
Auxiliary contacts 2NO+2NC main				<input type="text"/>
Auxiliary contacts 2NO+2NC E/S				<input type="text"/>
Key lock	LBS Open <input type="checkbox"/> LBS Close <input type="checkbox"/>		E/S Open <input type="checkbox"/> E/S Close <input type="checkbox"/>	
Pressure gauge	None <input type="checkbox"/>	Presence <input checked="" type="checkbox"/>	(Selection recommended)	
Voltage detection system	None <input type="checkbox"/>	Presence <input type="checkbox"/>		
Control voltage (Including lamp)	24 Vdc <input type="checkbox"/> 48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/> 220 Vac <input type="checkbox"/>	
Low voltage control cabinet	Default only <input type="checkbox"/>	Add. top <input type="checkbox"/>		
Heater with thermostat	50W <input type="checkbox"/>	100W <input type="checkbox"/>		

Order form

Compact AIS - CU-AP (Circuit breaker unit with PT)

Basic cubicle				Quantity <input type="text"/>
Rated voltage, Ur	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>	
Service voltage				(kV) <input type="text"/>
Short-circuit current, I_{sc}				(kA) <input type="text"/>
Rated current, I_r				(A) <input type="text"/>
Internal arc withstand	None <input type="checkbox"/>	21kA/1s <input type="checkbox"/>	A-FLR <input type="checkbox"/>	
Position in the switchboard	First on left <input type="checkbox"/>	Middle <input type="checkbox"/>	Last on right <input type="checkbox"/>	
Vacuum circuit breaker type	Fixed <input type="checkbox"/>			
CT				See p.44
VT				See p.44
Protection relay	Gipam 10 <input type="checkbox"/>	Gipam 2000 <input type="checkbox"/>	X-Gipam <input type="checkbox"/>	For others, discussion is needed.
Earthing switch at cable side	E0 <input type="checkbox"/> Lock Coil <input type="checkbox"/>	E1 <input type="checkbox"/> VD <input type="checkbox"/>	4a4b <input checked="" type="checkbox"/>	(Short-circuit making capacity) (4a4b contact is default.)

Option				
Electrical driving motorization	24 Vdc <input type="checkbox"/> 48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/> 220 Vac <input type="checkbox"/>	
Auxiliary contacts 2NO+2NC main				<input type="text"/>
Auxiliary contacts 2NO+2NC E/S				<input type="text"/>
Key lock	LBS Open <input type="checkbox"/> LBS Close <input type="checkbox"/>	E/S Open <input type="checkbox"/> E/S Close <input type="checkbox"/>		
Pressure gauge	None <input type="checkbox"/>	Presence <input checked="" type="checkbox"/>	(Selection recommended)	
Voltage detection system	None <input type="checkbox"/>	Presence <input type="checkbox"/>		
Control voltage (Including lamp)	24 Vdc <input type="checkbox"/> 48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/> 220 Vac <input type="checkbox"/>	
Low voltage control cabinet	Default only <input type="checkbox"/>	Add. top <input type="checkbox"/>		
Heater with thermostat	50W <input type="checkbox"/>	100W <input type="checkbox"/>		
Block type CT	<input type="checkbox"/>	250 mm box is added.		

Compact AIS - GAU (Incoming cable-connection unit)

Basic cubicle				Quantity <input type="text"/>
Rated voltage, Ur	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>	
Service voltage				(kV) <input type="text"/>
Short-circuit current, I_{sc}				(kA) <input type="text"/>
Rated current, I_r				(A) <input type="text"/>
Internal arc withstand	None <input type="checkbox"/>	21kA/1s <input type="checkbox"/>	A-FLR <input type="checkbox"/>	
Position in the switchboard	First on left <input type="checkbox"/>	Middle <input type="checkbox"/>	Last on right <input type="checkbox"/>	
Earthing switch at cable side	E0 <input type="checkbox"/> Lock Coil <input type="checkbox"/>	E1 <input type="checkbox"/> VD <input type="checkbox"/>	4a4b <input checked="" type="checkbox"/>	(Short-circuit making capacity) (4a4b contact is default.)

Option			
Voltage detection system	None <input type="checkbox"/>	Presence <input type="checkbox"/>	
Control voltage (Including lamp)	24 Vdc <input type="checkbox"/> 48 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/> 220 Vac <input type="checkbox"/>
Low voltage control cabinet	Default only <input type="checkbox"/>	Add. top <input type="checkbox"/>	
Heater with thermostat	50W <input type="checkbox"/>	100W <input type="checkbox"/>	
Surge arrester	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>

Order form

Compact AIS - SU (Section unit)

Basic cubicle				Quantity <input type="text"/>
Rated voltage, Ur	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>	
Service voltage				(kV) <input type="text"/>
Short-circuit current, I_{sc}				(kA) <input type="text"/>
Rated current, I_r				(A) <input type="text"/>
Internal arc withstand	None <input type="checkbox"/>	21kA/1s <input type="checkbox"/>	A-FLR <input type="checkbox"/>	
Position in the switchboard	First on left <input type="checkbox"/>	Middle <input type="checkbox"/>	Last on right <input type="checkbox"/>	
Vacuum circuit breaker type	Fixed <input type="checkbox"/>			
CT				See p.44
Protection relay	Gipam 10 <input type="checkbox"/>	Gipam 2000 <input type="checkbox"/>	X-Gipam <input type="checkbox"/>	For others, discussion is needed.

Option				
Electrical driving motorization	24 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/>	
	48 Vdc <input type="checkbox"/>		220 Vac <input type="checkbox"/>	
Auxiliary contacts 2NO+2NC main				<input type="text"/>
Auxiliary contacts 2NO+2NC E/S				<input type="text"/>
Key lock	LBS Open <input type="checkbox"/>		E/S Open <input type="checkbox"/>	
	LBS Close <input type="checkbox"/>		E/S Close <input type="checkbox"/>	
Pressure gauge	None <input type="checkbox"/>	Presence <input checked="" type="checkbox"/>	(Selection recommended)	
Voltage detection system	None <input type="checkbox"/>	Presence <input type="checkbox"/>		
Control voltage (Including lamp)	24 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/>	
	48 Vdc <input type="checkbox"/>		220 Vac <input type="checkbox"/>	
Low voltage control cabinet	Default only <input type="checkbox"/>	Add. top <input type="checkbox"/>		
Heater with thermostat	50W <input type="checkbox"/>	100W <input type="checkbox"/>		

Compact AIS - MU (Metering unit)

Basic cubicle				Quantity <input type="text"/>
Rated voltage, Ur	12kV <input type="checkbox"/>	17.5kV <input type="checkbox"/>	24kV <input type="checkbox"/>	
Service voltage				(kV) <input type="text"/>
Short-circuit current, I_{sc}				(kA) <input type="text"/>
Rated current, I_r				(A) <input type="text"/>
Internal arc withstand	None <input type="checkbox"/>	21kA/1s <input type="checkbox"/>	A-FLR <input type="checkbox"/>	
Position in the switchboard	First on left <input type="checkbox"/>	Middle <input type="checkbox"/>	Last on right <input type="checkbox"/>	
CT				See p.44
VT				See p.44

Option				
Electrical driving motorization	24 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/>	
	48 Vdc <input type="checkbox"/>		220 Vac <input type="checkbox"/>	
Auxiliary contacts 2NO+2NC main				<input type="text"/>
Auxiliary contacts 2NO+2NC E/S				<input type="text"/>
Key lock	LBS Open <input type="checkbox"/>		E/S Open <input type="checkbox"/>	
	LBS Close <input type="checkbox"/>		E/S Close <input type="checkbox"/>	
Pressure gauge	None <input type="checkbox"/>	Presence <input type="checkbox"/>		
Control voltage (Including lamp)	24 Vdc <input type="checkbox"/>	110 Vdc <input type="checkbox"/>	110 Vac <input type="checkbox"/>	
	48 Vdc <input type="checkbox"/>		220 Vac <input type="checkbox"/>	
Low voltage control cabinet	Default only <input type="checkbox"/>	Add. top <input type="checkbox"/>		
Heater with thermostat	50W <input type="checkbox"/>	100W <input type="checkbox"/>		

A large empty rectangular box with a thin black border, intended for writing a memo.



Safety Instructions

- For your safety, please read user's manual thoroughly before operating.
- Contact the nearest authorized service facility for examination, repair, or adjustment.
- Please contact qualified service technician when you need maintenance. Do not disassemble or repair by yourself!
- Any maintenance and inspection shall be performed by the personnel having expertise concerned.



- According to The WEEE Directive, please do not discard the device with your household waste.



www.ls-electric.com

■ Headquarter

127 LS-ro (Hogye-dong) Dongan-gu, Anyang-si, Gyeonggi-Do, 14119, Korea

■ Seoul Office

LS Yongsan Tower, 92, Hangang-daero, Yongsan-gu, Seoul, 04386, Korea
Tel. 82-2-2034-4916, 4684, 4429

■ Overseas Subsidiaries

- **LS ELECTRIC Japan Co., Ltd. (Tokyo, Japan)**
Tel: 81-3-6268-8241 E-Mail: japan@ls-electric.com
- **LS ELECTRIC (Dalian) Co., Ltd. (Dalian, China)**
Tel: 86-411-8730-5872 E-Mail: china.dalian@lselectric.com.cn
- **LS ELECTRIC (Wuxi) Co., Ltd. (Wuxi, China)**
Tel: 86-510-6851-6666 E-Mail: china.wuxi@lselectric.com.cn
- **LS ELECTRIC Vietnam Co., Ltd. (Hanoi, Vietnam)**
Tel: 84-93-631-4099 E-Mail: vietnam@ls-electric.com
- **LS ELECTRIC Middle East FZE (Dubai, U.A.E.)**
Tel: 971-4-886-5360 E-Mail: middleeast@ls-electric.com
- **LS ELECTRIC Europe B.V. (Hoofddorp, Netherlands)**
Tel: 31-20-654-1424 E-Mail: europartner@ls-electric.com
- **LS ELECTRIC America Inc. (Chicago, USA)**
Tel: 1-800-891-2941 E-Mail: sales.us@lselectricamerica.com
- **LS ENERGY SOLUTIONS LLC (Charlotte, USA)**
Tel: 1-704-587-4051 E-Mail: cmfeldman@ls-es.com
- **LS ELECTRIC Turkey Co., Ltd. (Istanbul, Turkey)**
Tel: 90-212-806-1252 E-Mail: turkey@ls-electric.com

■ Overseas Branches

- **LS ELECTRIC Tokyo Office (Japan)**
Tel: 81-3-6268-8241 E-Mail: tokyo@ls-electric.com
- **LS ELECTRIC Beijing Office (China)**
Tel: 86-10-5095-1631 E-Mail: china@lselectric.com.cn
- **LS ELECTRIC Shanghai Office (China)**
Tel: 86-21-5237-9977 E-Mail: china@lselectric.com.cn
- **LS ELECTRIC Guangzhou Office (China)**
Tel: 86-20-3818-2883 E-Mail: china@lselectric.com.cn
- **LS ELECTRIC Chengdu Office (China)**
Tel: 86-28-8670-3201 E-Mail: china@lselectric.com.cn
- **LS ELECTRIC Qingdao Office (China)**
Tel: 86-532-8501-2065 E-Mail: china@lselectric.com.cn
- **LS ELECTRIC Nanjing Office (China)**
Tel: 86-25-8467-0005 E-Mail: china@lselectric.com.cn
- **LS ELECTRIC Bangkok Office (Thailand)**
Tel: 66-90-950-9683 E-Mail: thailand@ls-electric.com
- **LS ELECTRIC Jakarta Office (Indonesia)**
Tel: 62-21-2933-7614 E-Mail: indonesia@ls-electric.com
- **LS ELECTRIC Moscow Office (Russia)**
Tel: 7-499-682-6130 E-Mail: info@lselectric-ru.com
- **LS ELECTRIC America Western Office (Irvine, USA)**
Tel: 1-949-333-3140 E-Mail: america@ls-electric.com
- **LS ELECTRIC India Office (India)**
Tel: 91-80-6142-9108 E-Mail: info_india@ls-electric.com
- **LS ELECTRIC Singapore Office (Singapore)**
Tel: 65-6958-8162 E-Mail: singapore@ls-electric.com



Technical Question or After-sales Service

Customer Center-Quick Responsive Service, Excellent technical support

82-1644-5481